POWER

McGraw-Hill Publishing Co., Inc., 330 West 42nd St., New York, N. Y.

GENERAL INDEX TO VOLUME LXXIX

JANUARY—DECEMBER, 1935

January	Pages	1-56
February	"	57-112
March	"	113-168
April	"	169-226
May	"	227-282
June	"	283-342
July	"	343-400
August	"	401-456
September	"	457-512
October	"	513-568
November	"	569-624
December	"	625-684
Mid-December	"	685-748

A

ACCIDENTS AND ACCIDENT PREVENTION — Page

Compressor explosions. A. F. Rieber....*522
Elevated equipment needs obstruction lights. S. H. Coleman 150
Explosion in coal-pulverizing plant. W. E. Warner 96
Operating engineer remembers. S. H. Coleman 153
Preventing explosions in compressed air systems. R. McLaren 550
St. Croix Paper operates 3,000,000 hours without lost-time accidents *570
Three penstock accidents in 1934..... 235

AIR COMPRESSORS

Compressed-air explosions can be prevented. M. E. Wagner 608
Compressor freeze-ups 657
Effect of clearance on air compressor performance 42
Frequency of explosions reduced. M. C. Nye 440
Oil flash point and compressed-air explosions. B. E. Lingar 440
Preventing explosions in compressed-air systems. R. McLaren 550
Propeller blowers (A.S.M.E. meeting). 693
Protecting air compressors against explosions Reill, Woodle, Rivett, Harden, Williamson, Baker 386
Stationary air compressor made portable. Abe Rocklin 605
Unit for judging air compressors. Arthur Korn *312
Valve stud on air compressor repaired. J. M. Pomeroy..... *262
Why air compressor explosions. A. F. Rieber *522

AIR CONDITIONING

A.S.R.E. meeting discusses air conditioning 708
Air washers provide moisture to order. R. B. Purdy *140
Chart for determining investment return on air conditioning (Power's Data Sheets) 604
Conditioned air: no drafts—distribution data. R. B. Purdy *580
Cooling towers at Macy's. Mosher & Wellbrock *656
Experiments in air conditioning single offices (A.S.H.V.E. meeting) 162
15 years—comparison of power in 1920 and now. P. W. Swain *686
Filtering conditioned air R. B. Purdy..*254
Hershey windowless building installing air conditioning 620
How much air for conditioning. A. W. Canney *368
Humidity control with brine spray. W. H. Martin 20
It ain't the heat—it's the humidity. R. B. Purdy *76
Maintenance of heating, ventilating and air conditioning units 182
Position of the air washer. R. B. Purdy *197
Quiet fans for air conditioning. A. W. Canney *424
Refrigeration for air conditioning. R. B. Purdy *530
Sugar warehouse uses electric heat to control humidity. G. J. Kalwitz.... 243
When heaters help condition air. R. B. Purdy 320
American Boiler Mfrs. Assn.—Meeting at Skytop, Pa. 394
American Institute of Electrical Engineers—Ithaca convention 395
Symposium on transformers at New York convention *98
Transmission of electric power by electronics and d.c. motor with thyratron equipment discussed at New York meeting *156
American Society for Testing Materials—Committees hold meetings 221
Detroit meeting 339, 450
American Society of Civil Engineers and American Society of Mechanical Engineers—Hold joint power session.... 106
American Society of Heating & Ventilating Engineers—Buffalo meeting 162
Toronto meeting 339, 385
American Society of Mechanical Engineers—Annual meeting—report of power session *692
Highlights of annual meeting.....704
New officers elected *701
Oil & Gas Power Division meets at Tulsa reported by M. J. Reed 294
Practical pointers selected from A.S.M.E. and A.S.R.E. papers 702
Program of meeting 619
Report of Cincinnati meeting.....*373
American Society of Refrigerating Engineers—New York meeting *708
Practical pointers selected from A.S.M.E. and A.S.R.E. papers 702
American Welding Society—Annual meeting 451
Ash handling—Water for sluicing ash. White, Karassik, Myers, Pratt, Kraus, Butcher 555
Association of Iron & Steel Electrical Engineers—Pittsburg meeting 618
Auxiliaries—Efficiency of auxiliaries is important. H. T. Watts 265
Awards—Edison medal won by Willis R. Whitney 49
Holly medal presented to Dr. I. Langmuir *374

B

BEARINGS

As diesel engines speed up, their bearings suffer. J. W. Anderson..... 200
Micarta-lined waterwheel bearings. V. Enz *407
Shoe-type guide bearings for hydro generators. R. Baudry *541
Thrust bearings loaded to destruction. H. A. S. Howarth 211
Turbine-generator bearings repaired by welding. G. W. Devine *549

BELTS

Capacity of conveyor belting (Power's Data Sheets) 206
Flat belts on short centers *366
How to keep belts from climbing pulley flanges 670
Multiple V-belts—how to select and operate them *590
Rubber belts—how they're made, used and where *248
Binary cycles—Mercury vapor station of Public Service Electric & Gas Co., Kearny, N. J. *348

BOILERS

Automatic control of stoker fired boilers *331
Baffles for boilers *641
Bends tubes to install them in boiler. E. A. Gilbert *382
Bibliography of boilers 632
Bituminous coal and lignite burned in combination. C. L. Alexander *548
Boiler capacity ratings. C. F. Dixon....*429
Boiler-tube failure caused by improper soot-blower installation. Julius Brodsky *151
Boiler tube replaced in two sections. Carter, Spring 97; Noble 210
Boilers today *629
Bonus based on 3-month performance in central station. N. T. Pef..... 258
Bonus or prize system is advantageous. Mark Bell 496
Bonus system. Joseph O'Brien 383
Bonus systems for power plant employees. N. A. Miner 265
Bonus systems for power plants. Street. Van Kenyon, Rieber 100
Bonus system for the boiler room.... 327
Broadmoor Hotel, Colorado Springs, replaces three lignite-fired boilers with one gas-fired unit. Cook, Monaghan & Tutt *528
Brown Co., Berlin, N. H., raises efficiency of electric steam boiler 50%. F. A. Westbrook *196
Burner boxes should be kept free of pulverized coal. C. L. Alexander....*494
Buzzard Point uses photo cells for boiler control. C. E. Miller *646
Cause of false water level in water column. M. E. Wagner 153
Caustic embrittlement discussed by feedwater session of A.S.M.E..... 699
Cheaper, better steam (Ed)..... 625
Chemical deaeration of boiler feedwater. L. D. Betz 497
Chemical deaeration of boiler feed water. S. T. Powell, pt. 1 304; pt. 2 *362
Coal-feed regulator. F. T. Pollock.....*324
Colorado Springs municipal plant's gas fired boilers controlled electrically...*115
Crushed firebrick to make refractory patches. C. C. Hermann 533
Cutting in a boiler. R. A. Hafford.... 668
Designer's problems on boilers.....*634
Does a trap consume steam? Kraus, Kramer 442
Drums and headers for boilers.....*644
Engine indicator records boiler blowdown. T. M. Street *323
15 years — comparison of power in 1920 and now. P. W. Swain.....*686
Firebrick shapes, 37 standard 9-in.....*460
Firestone installs a 14,000-lb. boiler and a 10,000 back pressure turbine. W. K. Adkins *58
Forecasting fan performance if conditions change. H. R. Phelps..... 195
Fuel-oil valve operated from damper regulator. C. C. Hudson *606
Furnace sheet bulge repaired. H. M. Spring, Jr. *95
Furnaces of 1935 (Ed) 457
Header steam storage will run plant one second. J. O. G. Gibbons..... *21
Home-made boiler *490
How to balance the water in your boilers. R. T. Sheen 654
How to build a monolithic baffle. B. W. Wheeler *198
How to lay up refractory *462
Kilowatt boilers? 137
Lignite as fuel for steam generation. Edward Green 322
Maintenance in the boiler room.....*173
Mechanicoaling (picture feature)..... 33
1934 developments in steam equipment. *6
1934 obsolescence survey 27
Pipeline drainage from boilers. Shafer, Spring, Nee, Gibbons, Kramer..... 500
Power boilers — types, manufacturers (table) 633
Provide access doors for slag removal. S. H. Coleman 493
Refractories for boilers 458
Richmond Station adds 165,000 Kw. Hopping & Fairchild *402
Riveted and welded joints in boiler shells and drums *640
Safe ending extends life of boiler tubes. H. A. Wiggins 152
Safe furnace proportions prevent smoke. H. R. Carr *596
St. Croix Paper cuts steam costs 60% by modernization of power plant....*570
Sixteen tubes fail in boiler. N. T. Pef. 439
Slag-tap furnaces discussed at A.S.M.E. meeting 374
Spraying combustion chambers with aluminum 143
Standby boiler corrosion. Cook, Nee, Hunt, Dunn, Spring 498
Steam cleaners and dryers for boilers. *642
Steam costs cut by correcting boiler room faults. C. W. McBreen 130
Steam plant errors. F. H. Browning, pt. 1 *428; pt. 2 how water acts in a boiler *482; pt. 3 cutting in a boiler.*542
Superheater circulation to prevent overheating. Bock, Myers, Kee, Frief, White, Pef 212
Superheaters *636
Suspended walls and arches *465
Test your own boilers. W. H. Wood, pt. 1 *302; pt. 2 *360; pt. 3 *414; pt. 4 *485; pt. 5 534; pt. 6.....*598
Towboat licks cylinder oil in boilers. A. C. Stutson *582
Tubes replaced in two parts. G. H. Ashmore 440
26 typical American boilers *626
Typical boiler defects 578
Vent open or closed when filling boilers? Cuthbertson, Johnston, Pef, Barnes, Baker, Nye 266
Watch that water column. C. A. Armstrong 381
Water-cooled walls *468
Water walls *638
West Virginia Pulp & Paper, Covington plant uses automatic control for new boiler. E. H. Barry *252
West Virginia Pulp & Paper Co.'s new boiler has automatic control.....*192
West Virginia Pulp & Paper replaces two plants with one 600 lb. boiler. E. H. Barry *69
What governs furnace size? *470
World's largest boiler at Ford's Rouge plant. Thomas Wilson *66

BOOK REVIEWS

A.S.H.V.E. guide 157
A.S.T.M. standards on coal and coke... 157
Air conditioning, Edison Electric Institute 669
Air conditioning and engineering..... 271
Automatic protection of A-C circuits. G. W. Stubbings 271
Axialgebläse vom standpunkt der tragflugeltheorie. C. Keller 157
Book of the A.S.T.M. tentative standards 99
Cast metals handbook 613
Chemical engineering plant design. F. C. Vilbrandt 99
Combustion—Edison Electric Institute.. 669
Compressed air data, ed. by F. W. O'Neil 99
Dampfkesselschaden. Ernst Pfleiderer.... 669
Diesel and other internal combustion engines. H. E. Degler 389
Diesel engine design. H. F. Shepherd. 99
Diesel engines. J. W. Anderson..... 557
Diesel handbook. Diesel Rosbloom..... 215
Discussion of economic principles of underlying electricity service and rates 157
Electric elevators. P. A. Arnet..... 389
Electrical engineering. C. L. Dawes.... 45

(*) Illustrated. (Ed.) Editorial

Page

Elimination of taste and odor in water. J. R. Baylis 389
Equipment and machinery eligible for modernization—FHA 669
Fans. Theodore Baumeister..... 501
Federal Power Commission electric rate survey 389, 445
Flow of gas through coal. Burke & Parry 157
General harbor regulations, 1935. New Zealand 669
Generating stations. A. H. Lovell..... 557
Handbook of chemistry, ed. by N. A. Lange 45
Handbook of chemistry and physics. C. D. Hodgmans 45
Heating and air conditioning. Allen & Walker 557
Hydraulic laboratories in the U. S..... 669
Industrial electronics. Gulliksen & Vedder 613
Industrial furnaces. W. Trinks..... 99
Introduction to mechanics and heat. N. H. Frank 335
JS-diagrams for combustion gases of correct and weak mixtures. Tanaka & Awano 669
Keystone coal buyer's manual 1933. ed. S. A. Hale 557
Lewis' new air conditioning for comfort. S. R. Lewis 613
Lubricating oil tests. J. I. Clower..... 157
Marketing industrial equipment. Bernard Lester 157
Mechanics of materials. George & Rettger 271
Metal cleaning handbook. R. W. Mitchell 669
Modern diesel 613
Multiple retort gravity-underfeed stoker. W. M. Dodds 669
National public works, an inquiry by the League of Nations 215
Noise—comprehensive survey from every point of view. N. V. McLachlan.... 501
Oil and gas engines. Edison Electric Institute 669
Performance expectancy of domestic underfeed stokers for anthracite. A. J. Johnson 157
Power operators guide, ed. by E. J. Tangerman 445
Practical mechanics of motion. J. F. Mangold 445
Primer of money. Woodward & Rose.. 335
Principles of alternating current. R. R. Lawrence 215
Principles of motor fuel preparation and application. A. W. Nach..... 215
Principles of motor fuel preparation and application. Nash & Howes 501
Scientific papers and addresses of Sir Chas. A. Parsons 335
Smoke prevention 669
Specification and test methods for cold-set cements. S. M. Phelps 669
Steam turbines. E. F. Church..... 445
Theory of alternating current wave forms. Philip Kemp 271
Unbalance in alternating-current rotating machines. E. M. Sabbagh 157
Underfeed combustion, effect of preheat and distribution of ash in fuel beds. P. Nicholls 157
Variables in coal sampling. Morrow & Proctor 669
Water as an engineering and industrial material. S. T. Powell..... 157
Water power engineering. H. K. Barrows 45
What about direct loans to industry?.. 669
Business (Ed) 569, (Ed) 227

C

Canadian Electric Assn.—Annual convention 375
Cavitation. See Water power.
Charts, scaling your. A. A. Merrill.....*148
Chimneys—How high and what diameter for power plant chimneys? H. C. Oatley *246
Insulated stack to prevent corrosion. H. A. Crego *209
Circle, formula for diameter. H. C. Curtiss. 496

COAL

Automatic handling equipment for delivering coal to silos. R. F. Emerson..*524
Bituminous coal and lignite burned in combination. C. L. Alexander.....*548
Buckwheat No. 4 used as fuel. W. S. Johnston 486
Consumption of coal in British plant. W. L. Abbott 550
Fuels session of A.S.M.E. discusses stokers 694
How to avoid sticking coal. Pef, Pierce, Welch 101
Mechanicoaling (picture feature)..... 33
Studies on the ash in coal (A.S.H.V.E. meeting) 162
Tir John, new British station, burns anthracite. David Brownlie.....*645
Codes—API-ASME unfired vessel code.... 106
Combustion—Adjustments rejuvenate combustion control. T. F. Norris..... *22
1 cu.ft. air burns 100 B.t.u. J. O. G. Gibbons 413
West Virginia Pulp & Paper Co's new boiler has automatic control.....*192
Combustion turbine and its future. W. E. Trumpler *78
Compressed air—Proper draining keeps air lines free of water. C. C. Phelps....*150

CONDENSERS

Bacteria immune to chlorine. Welch, Starkweather, Cook, Lingar 611
Hydrogen frequency changer for Freemansburg, Pa. *263

Page

Scale formation in condensers. B. F. Hege 263
What about condenser tube scale? French, Holaday 44
What about condenser tube scale? K. G. Hoffman 210
Contracts—when is a power engineer liable on contracts? L. T. Parker..... 552

CONTROL

Adjustments rejuvenate combustion control. T. F. Norris *22
Automatic control for two pumps in parallel. Max Pafenbach *37
Automatic zoned-air for Connors Creek stokers. Thomas Wilson *128
Car-switch control for elevators. M. S. Hill *256
Coal handling equipment for delivering coal to silos. R. F. Emerson.....*524
Colorado Springs municipal plant uses electrical control to make gas firing safe *115
Combustion control equipment for new boiler at Covington plant of West Virginia Pulp & Paper. E. H. Barry....*252
Distillery plant controlled by meters. F. A. Westbrook *433
Fuel-oil valve operated from damper regulator. C. B. Hudson *606
Make electrical controls tinker proof. J. E. Hyler 211
Meter control of stoker-fired boilers....*331
Photo cells for boiler control used by Buzzard Point. C. E. Miller.....*646
Photo-electric cell smoke alarm and higher stack reduces smoke in Seattle Gas. J. F. Pollard *518
St. Croix Paper Co. operates steam turbines from control board in boiler room. J. P. Topolosky *658
Straight-line diagrams simplify elevator control. C. A. Armstrong *423
Uniflow engine at Charlestown, Mass., on vacuum or off by lever shift.....*309
Variable speed pumps with water pressure regulating panel. I. L. Boyum..*232
Watch peak loads to cut purchased power costs. J. M. Acheson.....*244
West Virginia Pulp & Paper Co.'s new boiler has automatic control.....*192

COOLING TOWERS

Macy's cooling towers save $27,000 a year. Mosher & Wellbrock.....*656
McPherson, Kan., municipal steam plant builds new power house and adds forced-draft cooling tower. A. C. Kirkwood *236
Singer building has basement cooling tower *359

CORROSION

Corrosion of materials discussed at Canadian Electrical Assn. 375
Insulated stack to prevent corrosion. H. A. Crego *209
Lynn, Mass., Generating Station has difficulties with condenser tubes. J. A. Cook 239
Sprayed metal coatings 143
Spraying metal coatings. J. W. Gibbons..*230
Standby boiler corrosion. Cook, Nee, Hunt, Dunn, Spring 498

COSTS AND PERFORMANCE

Cheaper power with "topping turbine." N. D. Gove 412
Cincinnati General Hospital charts its heat and power *431
Cincinnati Hospital's power service costs. A. A. Fette 608
Efficiency of all auxiliaries is important. S. H. Coleman 550
Flue gas scrubbed to keep out sulphur in Great Britain. David Brownlie....*426
Hotel New Yorker shifts to oil. W. D. Lewis *652
Industrial plants reduce costs by better use of existing motors or substituting others. H. M. French *310
Interborough Rapid Transit saves $7,000,000 power. H. B. Reynolds....*514
Lynn, Mass., Generating Station has many operating problems. J. A. Cook 239
Mack Truck Co. replaces direct radiation with unit heaters and saves oil. A. J. Morrison *594
Operating brains. N. T. Pef 153
Operating costs of diesel plants..... 290
Rejuvenation of plant brings down heating costs. W. H. McCollum..... *74
Reserve capacity 238
Roger Smith Hotels costs of power during 1934 247
St. Croix Paper cuts steam costs 60% by modernization *570
Steam costs cut by correcting boiler room faults. C. W. McBreen 130
Watch peak loads to cut purchased power costs. J. M. Acheson *244

D

Dust recovery. See Smoke abatement.

E

Edison Electric Institute—Atlantic City meeting 337

ELECTRICITY

A.C. motors—torques, currents, slip. R. P. Guildford *576
Alarm indicator sounds for peak load. H. E. Stafford *262
Aligning bearings on a motor generator. Hunt, Bell, Long, Larson 328

Page

Aligning motor-generator with rotors in place. J. M. Myers *440
Amortisseur winding 670
Armature coil short circuit 39
Auto-transformer starts group of motors. C. A. Armstrong *96
Building up oil circuit breaker contacts. Baker, Hoffman, Young, Myers..... 268
Bus voltage held constant by automatic regulator. Montgomery, Stivender & Selleg *136
Buzzard Point uses photo cells for boiler control *646
Cincinnati Traction Bldg. buys electric power to save 26%. F. W. Bailey..*233
Circuit breaker contacts stand severe service. E. H. Beckert.....*441
Coal handling equipment to deliver to silos. R. F. Emerson.....*524
Colorado Springs municipal plant's gas fired boilers controlled electrically..*115
Combustion control equipment for new boiler at Covington plant of West Virginia Pulp & Paper. E. H. Barry.*252
Connors Creek stokers have automatic zoned-air. Thomas Wilson *128
Control valves for refrigerating systems. W. R. Kitzmiller *124
Cyclone dust collector vs. electrical precipitator. Henry Kreisinger..... 123
Defective connections cause trouble. R. B. Glenn 437
Defective primary lead causes noisy transformer operation. J. E. Wright.... 438
Deterioration of rubber covered wire. Hoffman, Young, Myers 154
Developments in electricity and meters in 1934 ..... *12
Dial gage checks alignment of motor generator. R. C. Baker..... 382
Direct to alternating current at constant frequency (College of the City of New York) *305
Electrical installation for a gold mine. N. L. Rea *204
Electroplating closes pores in cast-iron weld. L. H. Kendall *207
Electro-plating generators with overloaded brushes. L. L. Stoeffel..... 607
Electrostatic precipitators (A.S.M.E. meeting) 693
Elevator cars stop level with landings due to car switch control. M. S. Hill.*256
Elevator starting equipment. C. A. Armstrong *526
Emergency lights for boiler room. J. E. Wright *381
Exciter cannot maintain normal voltage 610
Federal regulation of the transmission of all electricity recommended by P.W.A. 49
Fuse adapted for use in heavy clips. T. E. Miller *37
How should the coils be grouped in a winding? 42
Improve unit commutation for better d.c. operation. C. Lynn *410
Induction motor bearings sometimes give trouble. R. M. Stevens 94
Loads and modernization—obsolescence survey 27
Magneto trouble caused by excessive temperature of gas engine. Elton Sterrett *149
Maintenance of electrical equipment....*184
Maintenance of generator bearing pedestal insulation. S. H. Coleman.... 96
Milwaukee Electric Railway & Light Co. ties in. Thomas Wilson *585
Oil switch heated excessively. R. B. Glen 607
Photo-electric cell smoke alarm and higher stack reduces smoke in Seattle Gas. J. F. Pollard.....*518
Proper, up-to-date motors reduce costs in industrial plants. H. M. French....*310
Rectifier changes double life of tubes. Arnold Benson *264
Rotary converter operates with shunt field open. R. B. Glenn 547
Rotary-converter trouble corrected by changed connections. R. B. Glenn..*665
Shaded-pole type motor reversed. J. E. Wright *495
Single-phase load on three phase system. 498
Stator cores tightened. L. A. Hunt....*437
Straight line diagrams simplify elevator control. C. A. Armstrong.....*423
Sugar warehouse uses electric heat to control humidity. G. J. Kalwitz.... 243
Synchronizing a small hydro generator. K. B. Humphrey 95
Telescopic exciters for Norris..... 480
Thermal relays tripped by high ambient temperature. H. B. Humphrey..... 151
Thyratron equipment for d.c. motor operation (A.I.E.E. convention).....*156
Today's efficiency 540
Torque for various horsepowers and speeds (Power's Data Sheets)..... 662
Transformer reactors. H. S. Knowlton 494
Transformer symposium at A.I.E.E. convention *98
Transmission of electric power by electronics (A.I.E.E. convention) *156
Truing collector rings with file on a rest. H. E. Stafford *380
Voltage affects d.c. machine parallel operation. Max Pafenbach..... 381
Watch peak loads to cut purchased power costs. J. M. Acheson.....*244
Water pressure regulation panel for variable-speed pumps. I. L. Boyum..*232
West Virginia Pulp & Paper Co.'s new boiler has automatic control.....*192
Why brushes stick in holders. W. E. Warner 211

(*) Illustrated. (Ed.) Editorial

Page

ELEVATORS

Automatic landing with car-switch elevators. M. S. Hill *256
Difference between automatic-leveling a[illegible] landing elevators.... 42
How [illegible] elevator service in large bu[illegible] White..... *357
Muni[illegible] elevator hoist ropes ma[illegible] ecord 659
Speci[illegible] e gibs quiet elevator ca[illegible] dgecumbe..... *147
Strai[illegible] rams simplify elevator co[illegible] Armstrong..... *423
Wax[illegible] elevator cables..... 386
Wha[illegible] ore the elevator begins to mov[illegible] A. Armstrong..... *526

ENGINEERING

Cooperation between consultant and operator. Mark Bell 667
Federal licensing. Hankins, Schneider, Bell 609
Licenses for engineers. C. G. Robinson 496
License the diesel engineer. H. D. White 668
Professional engineer's license 554
When is a power engineer liable on contracts? L. T. Parker..... 552
Engineers Council for Professional Development—Plans to accredit schools and certify engineers 220

ENGINES—INTERNAL COMBUSTION

As diesel engines speed up, their bearings suffer. J. W. Anderson..... 200
Centrifuging diesel lubricants. Baker, Shumaker, Wilkinson, White, Dingwall 329
Combustion turbine—prime mover of the future? W. E. Trumpler..... *78
Copenhagen diesel pinch hits for steam plant. H. W. Pye *72
Developments of diesel engines in 1934. E. J. Tangerman 10
Diesel centrifuging. D. M. Dempsey, G. D. N. 383
Diesel costs (A.S.M.E. meeting)..... 705
Diesel crankshafts—"hot spot" straightening 487
Diesel drill for oil W. C. Lane..... *650
Diesel engines—variable load analyzing. G. C. Boyer *370
Diesel exhaust heat rises steadily. Dickson, Dingwall, Bell 610
Diesel maintenance logs (Power's Data Sheets) 260
Diesel maintenance pointers..... 261
Diesel or gasoline 664
Diesel plant accessory and supply manufacturers 296
Diesels a la carte (Ed) 283
Diesels in the oil fields discussed at Tulsa meeting of Oil & Gas Power Division of A.S.M.E. reported by M. J. Reed.. 294
Diesels stand out at Motor Boat Show. 108
Exhaust-gas turbo blowers for supercharging diesels. Willis, Ludwickson. *326
15 years—comparison of power in 1920 and now. P. W. Swain *686
Fuel for high-speed diesels. G. C. Wilson 553
Gas-engine magneto trouble caused by excessive temperature. Elton Sterrett.. *149
Gas-engine exhaust valve seat tightened for repair. Elton Sterrett..... *439
How diesel plants purify oil. B. S. Lingar 383
How many diesels and what size—D.E.M.A. suggestions *592
Indicator diagrams — diesel engine (Power's Data Sheets) *546
Ignition and combustion of diesel fuels 705
License the diesel engineer. H. D. White 668
Litchfield, Minn., adds diesel-generator to municipal plant. Charles Foster.. *144
Mixed power plants—how diesel can help out steam. P. M. Thayer..... *416
Oil and gas engine overhauling..... *179
178 typical new diesel plants 292
Paris paper puts in sub-cellar diesel plant 163
Pit engine muffler. J. G. Latta *325
Rockford Screw Products heats shop with heat in diesel jacket water *601
Shrewd diesel plant design means cheaper power. P. M. Thayer 126
Singer building improves heat balance of plant with diesel set on springs..... *299
Squish 119
Superchargers for diesel engines. B. E. Fernow 211
Superchargers or another diesel. Sidler, Cater 40
Turbine, internal-combustion. W. E. Trumpler *532
Uses, costs, builders of diesels..... *284

ENGINES—STEAM

Automatic valve controls exhaust pressure. F. E. Bateman *94
Eliminating oil from engine exhaust. E. J. Vonachen 153
Engine and turbine overhauling..... *177
Engine speed 386
Indicator cards from single valve engine (Power's Data Sheets) *378
Indicator diagrams — non-releasing 4 valve engine (Power's Data Sheets). *436
Indicator diagrams—uniflow steam engine (Power's Data Sheets)..... *492
Maintaining steam traps 535
Model for triple-expansion marine engine *584
1934 obsolescence survey 27
Should shoulders be put in wristpins. Peters, Barry, O'Regan 388
Two old engines. C. A. Green..... 199
Uniflow on vacuum or off by lever shift at Charlestown, Mass..... *309

Page

EQUIPMENT—NEW

Air bell for Orsat *446
Air conditioner, portable *218
Air-conditioning unit *560
Air filter and separator *447
Analyzer, industrial *103
Annunciator unit *561
Atomizer, metal *447
Batteries, diesel starting *393
Bearing housing closures *333
Bearing, roller *673
Bearings, non-metallic 615
Belt, compensated 216
Belt, oil resistant 504
Belt splice, vulcanized *274
Belt, transmission 672
Blower *333, 674
Blower, centrifugal *272
Boiler, water-tube *676
Brake lining 672
Breaker, circuit *615
Brine system corrosion control..... 615
Bronze, short length bearing 48
Brush, heavy duty *273
Brush seater *105
Bucket, grab *447
Burner, cinder *558
Bus supports *675
Cable, elevator 677
Cable, lead covered 273
Cable, paper-insulated 393
Cable, welding 615
Calculation and function table 677
Capacitors, sealed 161
Castings, non-corrosive 335
Cement, acidproof 159
Cement, insulating *448
Circuit breaker *104, *674
Circuit breaker—oil blast 335, *505
Circulator, water *161
Cleaner, industrial *334
Cleaner, tube *334, *504, *677
Cleaning tool, steel *218
Clutch, friction *103
Colorimetric testing kits *558
Compressor *561
Compressor, air *332, *673
Compressor, air or gas *161
Compressor, horizontal single stage.... *159
Compressor, portable *561
Compressor, single stage *103
Compressor, steam booster *219
Compressor, water cooled *160
Concrete hardener 46
Concrete, refractory *392, 614
Condensate return unit *504, 561
Condenser, ammonia *503
Condensing unit *333, *332, *392
Conduit, tile *274
Conduit, underground steam..... *219
Connector, cable 676
Connector, welding cable *614
Contactors *559
Control, combustion *218
Control, humidity, system *46
Control, hydraulic speed *504
Control, synchronizing *390
Control, temperature, for internal combustion engines *391
Control for heating system *676
Controllers *560, *615
Controllers, air operated *502
Controller, humidity *274
Controller, insertion-type humidity.... *275
Controller, pressure and relief *272
Controller, reset *391
Controller, static pressure *275
Controller, time-cycle *393
Controller, valve *614
Cooled unit *446
Cooling tower, indoor *217
Cooling towers, induced-draft 332
Cooling tower, multi stage *105
Couplers, airline *560
Coupling *503
Coupling, flexible..*48, *334, 393, *504, *673
Coupling, pipe *449
Crane, noiseless electric *105
Crusher, coal *390
Cutout and fuse, thermal *615
Cutter, belt *504
Cutters, pipe *160
Cutter, swivel head *47
Cutter, tubing *391
Diesel-generator set *391
Diesel power unit..... *672
Drill, electric *48, *617
Drive, variable-speed *673
Dust catcher *104
Dynamometer *161
Electrode 216
Electrode, hardfacing 218
Engine, diesel *102, *616
Engine, diesel 6 cyl..... *272
Filter, air *104, 334
Filter, diesel fuel 672
Filter, dry air *449
Finishes 673
Fire-fighting equipment *505
Floor plate, steel *272
Flux, brazing 334
Fuse *614
Fuse, drop out *333
Fuse, plug 105
Fuse puller *505
Gage, draft *161
Gage, indicating pressure *390
Gage, pressure *674
Gage, recording *160
Gas analyzer *615
Gasket 217
Gasket, forged iron *447
Generators, acetylene *504, *675
Goggles *160, *561
Goggles, chemical *273
Hammer, electric *505

Page

Header protection 502
Heater, deaerating *47
Heater, electric *614
Heater, fuel oil *673
Heater, hot water *561
Heater, single pipe built-in *46
Heater, unit *616, 673
Hose, compensated air *103
Hose, fire *391
Hydrometer *672
Hythergraph *502
Idler, conveyor *335
Indicator, blown-fuse *333, *673
Indicator for diesels, pressure time .. *158
Indicator, phase-rotation *614
Indicator, temperature *559
Indicator, viscosity *47
Insulating material of cement 390
Insulation, metal heat 47
Jack, hydraulic power *333
Joint, expansion *674
Light, neon pilot *447
Lubrication system *560
Lubricator, journal.....*103, *616
Main, unit steam *674
Manifold, acetylene cylinder *676
Meter, air *448, *675
Meter, area flow *47
Meter case *104
Meter, condensate *449
Meter, flow *102, *391, 561
Meter, fuel flow air *334
Meter panel 216
Meter, recording *448, *502
Meter, total time *505
Meters, turbine flow *449
Monel metal 219
Motor, convertible 217
Motor, gear *673
Motor, polyphase *449
Motor, variable speed *158
Motorpump *102
Nozzle, air *216
Oil cloud pour test apparatus..... 102
Oil seal 158
Oil separator *675
Oiler, automatic *560
Orifice, automatic adjustable *503
Orifice fitting *332, 617
Oscillograph, universal *559
Packing, pump 335
Packing, semi-metallic *675
Packing, shaft 104
Packing, spiral leather 392
Paint protector 503
Paint spray gun *159
Paper, isometric line *390
Pipe cutting machine *502
Pipe hangers *334
Position transmitter and recorder..... *274
Potentiometer, portable *159, 505
Potentiometer pyrometer, light beam... *273
Potentiometer Stabilog *216
Power unit, portable 503
Primer, zinc chromate 47
Psychrometer, thermo shield *504
Pull lift tool *503
Pulverizer, ball mill *558
Puverizer, bowl-mill *616
Pump, centrifugal....*48, *216, *334, *393, *449
Pump, centrifugal 559, 561, *617
Pump, centrifugal fire *275
Pump, chemical *274
Pump, diesel fuel injection..... *158
Pump, fuel oil *447
Pump, high lift *161
Pump, high vacuum *159
Pump, horizontal duplex *104
Pump, liquid *160
Pump, lubricant barrel *502
Pump, piston *217
Pump, rotary 616
Pump, turbine *332
Pump, vacuum *674
Pyrometer controller *103
Pyrometer, horizontal *392
Pyrometer, motor for *558
Pyrometer, lance type *103
Pyrometer, potentiometer *614
Ratchet control variable speed..... *503
Recloser, automatic *677
Recorder, draft pressure and differential.. *275
Recorder, multi color *105
Recorder, pressure *558
Reduction unit, helical gear *275
Refractory arches and walls, suspended.. *392
Regulator, branch feeder *560
Regulator, temperature *160, *219
Regulator, voltage.....*159, *273, *392
Relay, auxiliary 217
Relay control for charging *674
Relay, reset *616
Relays for rectifiers 674
Resistor, speed regulating *614
Review of power and mechanical equipment *709-*741
Rivet and anchor bolts *275
Rubber coating 392
Rubber covering 615
Rubber substitute 103
Rustproofing 675
Saws, pipe-hole *615
Scale elimination *103
Scale solvent for diesel exhaust headers 102
Separator, screen *502
Shackle, roller bearing *393
Sheaves 675
Signal, safety *274
Slide rule, circular 505
Speed changer *616
Speed reducer, motorized *102
Speed reducer, mounting for *559
Spray, metal 615
Stair tread *273
Starter, motor *219

(*) Illustrated. (Ed.) Editorial

Page

Starter, motor *560
Steam return system *559
Stoker *672
Stoker control system *561
Stoker gate clips *216
Stoker, hydraulically driven *158
Strainer, forged-steel *218
Supervisory system, automatic *448
Switch, blade *675
Switch, disconnect *559, *560
Switch, horizontal break *677
Switch, solenoid ... *48, *159, 217, 273, *275
Switch, solenoid-operated *217
Switchboard *676
Tap, anchor *46
Terminal, conductor *275
Test units 677
Tester, circuit *449
Tester, color oil 275
Tester, electrical apparatus *447
Texrope sheave *559
Thermostat for air conditioning *273
Thermostat, glass-inclosed *675
Tile, cork 217
Time control unit *448
Timer, electronic *675
Transmission, variable speed *274, *390
Trap, dust *46
Trap, steam ... *105, *273, *446, *505, *503
Truck, scoop *105
Turbine, auxiliary steam 46
Turbines, steam *676
Vacuum cleaning system *158
Vacuum cleaning system, stationary *219
Valve, blow-off *614
Valve, blow-off tandem *335
Valve, bonnet globe *559
Valve, clip type gate *218
Valve, control *104
Valve, diaphragm *449
Valve, flow regulating *390
Valve for copper tubing *504
Valve, lift-type *617
Valve, metal gate *449
Valve, plug type *274
Valve, pressure control *448
Valve, pump, with malikite disk *216
Valve reducing *48
Valve, relief *674
Valve, renewable gate *218
Valve, single seat *218
Valve, slow-opening gas *160
Valve, through flow *48
Ventilator, continuous ridge *617
Valve wheel, colored *390
Voltage adjuster *332, *616
Voltmeter, contact-making *393
Water gun *504
Water system *217
Water tender, automatic *159
Welder *333, *560
Welder, arc *219, *617
Welder, d.c. *676
Welder, engine-driven *672
Welder, vertical *272
Welding ells, stainless clad *159
Welding rod 617
Welding torch *502
Wire, weatherproof line 558
Wrench, pipe *558
Wrench, pneumatic *161
X-ray unit *617
Zeolite, natural 392

F

Fans—Fan testing discussed by A.S.M.E. meeting 700
Forecasting fan performance if conditions change. H. R. Phelps 195

FEEDWATER

Caustic embrittlement discussed by feedwater session of A.S.M.E. 699
Chemical deaeration of boiler feedwater. L. D. Betz 497
Chemical deaeration of boiler feedwater. S. T. Powell. pt. 1 304; pt. 2 *362
Efficiency of auxiliaries is important. H. T. Watts 265
Feedwater heater made of pipe and fittings. L. B. Brown *549
High pressure feed pump operation. H. M. Spring, Jr. *250
How to balance the water in your boilers. R. T. Sheen 654
1934 obsolescence survey for feedwater systems 27
Reducing oxygen 328
Tightening large feed water storage tanks. J. L. Young *439
Trouble in drinking water systems caused by hydraulic elevator. R. L. Parker. *39
Water extracted from milk used for feedwater at condensing plant 477
Zero soft water 212

FLUE GAS

Flue gas analysis. J. G. Fairfield (Ref. Bk. Sheet) *25, 36
Precipitators (A.S.M.E. meeting) 693
Scrubbed to remove sulphur in Great Britain. David Brownlie *426
Treatment at Battersea Station, London 163
Foreword—Elbow grease 113
Horizons and brass tacks 57
In spite of hell and high water 1
Sea room 227
Stitch in time 171

FUEL

Fuel values will be studied by new Joint Committee 49
Hawaiian sugar production uses bagasse for fuel with bleeder turbines. J. K. Fairchild *134

Page

High-speed diesel fuel. G. C. Wilson 553
Hotel New Yorker shifts to oil. W. D. Lewis *652
How to burn cracked fuel oils. T. A. Solberg 32
Ignition and combustion of diesel fuels. 705
Lignite as fuel for steam generation. Edward Green 322
1 cu.ft. air burns 100 B.t.u. J. O. G. Gibbons 413
Ice-cream plant goes to oil firing. P. R. Unger *420
Test your own boilers. W. H. Wood, pt. 1 *302; pt. 2 *360; pt. 3 *414; pt. 4 *485; pt. 5 534; pt. 6 ..... *598

G

Gas, natural, drives steam turbines of Los Nietos Producing & Refining Co. F. L. Kallam 201

H

Heat balance—Singer building improves heat balance of plant with diesel set on springs *299

HEATING AND VENTILATING

A.S.H.V.E. meets in Toronto 385
Air filtration for conditioning and ventilation. R. B. Purdy *254
Degree-day and wind velocity. Hoffman, Strong, Young 443
Fallacy No. 6. J. O. G. Gibbons 326
Feedwater heater made of pipe and fittings. L. B. Brown *549
Hotel in Chicago improves temperature control for heating system. Abe Rocklin 323
Industrial heating (A.S.H.V.E. meeting) 162
Knickerbocker Village—a problem in home heating. R. B. Purdy *314
Mack Truck Co. replaces direct radiation with unit heaters and saves oil. A. J. Morrison *594
Maintaining heating and air conditioning units 182
Minimum ventilation (A.S.H.V.E. meeting) 162
National District Heating Association meets at Philadelphia 384
New York General Post Office annex installs ventilating fans. H. L. Alt *354
New York General Post Office—heating problems. H. L. Alt *418
Position of the air washer. R. B. Purdy 197
Propeller blowers (A.S.M.E. meeting) .. 693
Refrigeration for air conditioning. R. B. Purdy *530
Rejuvenation of plant brings down heating costs. W. H. McCollum *74
Rockford Screw Products heats shop with heat in diesel jacket water *601
Sugar warehouse uses electric heat to control humidity. G. J. Kalwitz 243
Unit heater piping. C. C. Herman *23
Wet-bulb thermometer 266
When heaters help condition air. R. B. Purdy 320
Zoned heating a 30-story building. Reidl, Nee, Hoffman, Harden 213

HIGH PRESSURES AND TEMPERATURES

Compressed air explosions can be prevented. M. E. Wagner 608
Condensate under pressure 266
Firestone installs a 14,000 lb. boiler and a 10,000 back pressure turbine. W. K. Adkins *58
High pressure feed pump operation. H. M. Spring, Jr. *250
Piping for temperatures over 850 degrees. Crocker & McCutchan *90
Pressure (Ed) 114
Superimposing high pressure plant on existing low pressure unit may give cheaper power. N. D. Gove 412
Hydro-electric power plants. See Water power.

I

INSPECTION AND MAINTENANCE

Air compressor valve stud repaired. J. M. Pomeroy *262
Aligning bearings on a motor generator. Hunt, Bell, Long, Larson 328
Aligning motor generator with rotors in place. J. M. Myers 440
Arc welding for maintenance. C. M. Taylor *229
Bacteria immune to chlorine. Welch, Starkweather, Cook, Lingar 611
Beam clamp pipe hanger. Bernard Kramer *96
Boiler room equipment *173
Boiler tube replaced in two sections. J. E. Noble 210
Bolt starter for use in small space. Arthur Munch *264
Brick cleaning cleaver made from automobile spring. Frank Bentley *37
Cause of false water level in water column. M. E. Wagner 153
Cleaning oil from piping. Spring, Lingar, Brockner 670
Corning Glass Works fights the flood. Alfred Vaksdal *422
Crushed firebrick to make refractory patches. C. C. Hermann 533
Desk and roll for log sheets. C. A. Armstrong *607

Page

Defective connections cause trouble. R. B. Glen 437
Distance gage for liquid level. Roy Emison 97
Drilling oil grooves in a lathe. Frank Moore *493
Electrical equipment maintenance *184
Electrolytic action stopped in a deep well pump. E. C. Soares *208
Electroplating closes pores in cast-iron weld. L. H. Kendall *207
Eliminates dust to prevent brushes sticking in holders. K. B. Hoffman 327
Engine pipe failure. H. B. McDermid .. *665
Finds cause of pump having low capacity. C. W. Peters *605
First—a policy and a plan (Ed) 172
Flash light made into test lamp. H. G. Stoddard *494
Formula for diameter of a circle. H. C. Curtiss 496
Fuel-oil meter box needs light. J. E. Wright *151
Furnace sheet bulge repaired. H. M. Spring, Jr. *95
Gas-engine exhaust valve seat tightened for repair. Elton Sterrett *439
Generator vibrates on account of poor foundation. Max Pafenbach 207
Grease—what, when, why and where. J. I. Clower 408
Greases — where . . . how. J. I. Clower *476
Heating, ventilating and air conditioning units—maintenance 182
How to build a monolithic baffle. B. W. Wheeler *198
How to keep condensate out of conduits. Ragg, Edwards, Lingar, Pratt, Myers 554
"I suggest we." R. B. Glen 664
Key unbalances speed reducer. David Fliegelman 494
Ladder tool rest for refacing pulleys. H. Moore *605
Lubricates brush holders with graphite. W. E. Warner 608
Maintenance in general 191
Measuring circular sections. P. C. Bruhl. *379
Meters in maintenance *186
New disks on old valve stems. R. A. Hall *379
Nipple made from pipe coupling. Bunyan Kennedy *666
Oil and gas engines—hints and schedules *179
Oil on blading threw turbine out of balance. H. M. Spring, Jr. 149
Oil switch heated excessively. R. B. Glen 607
Paint, light and white *646
Paint, pointers on 663
Piece of belting makes step to reach valve. H. Moore *325
Plugged line wrecks pump during cleaning. W. E. Warner 607
Power transmission equipment's maintenance *188
Prevents oil leaks from air cleaner. Elton Sterrett *209
Pumps sometimes need new valves instead of replacing. P. Scagne *149
Queen of Bermuda's whistle ground and welded to prevent leaks *259
Release the brake when gaging hoist motor. J. M. Pomeroy 210
Removing paint from transformer radiators. David Hearn *323
Rubber tubing for manhole gaskets. S. A. Warren *381
Safety first steam hose connections. S. H. Cooke *38
Scale formation in condensers. B. F. Hege 263
Scale in venturi tube. W. H. Peters 263
Separating oil from exhaust steam. Frank McLean 150
Sheet metal punch. R. C. Brown *39
Should shoulders be put on wristpins. Peters, Barry, O'Regan 388
Sixteen tubes fail in boiler. N. T. Pef. 439
Spiral springs made with piece of wire. R. A. Hall *438
Spraying metal coatings. J. W. Gibbons. *230
Stator cores tightened. L. A. Hunt *437
Steam costs cut by correcting boiler room faults. C. W. McBreen 130
Steam plant errors. F. H. Browning, pt. 1 *428; pt. 2 how water acts in a boiler *432; pt. 3 cutting in a boiler .. *542
Steam trap maintenance 535
Stitch in time (Ed) 171
Success with a pint 303
Tank sweating eliminated by coating. Wm. Bohlinger 605
Tightening large feed-water storage tanks. J. L. Young *439
Time recorder made from round-chart meter. J. G. Latta *438
Torch, arc and spray, welding and spraying tips *190
Towboat licks cylinder oil in boilers. A. C. Stutson *582
Transfers holes from cylinder to cylinder head. H. Moore *94
Truing collector rings with file on a rest. H. E. Stafford *380
Turbine and engine overhauling *177
Universal jointed packing screw. C. H. Willey *39
Vacuum cleaning the power plant. F. W. Lieberg *352
Valve-seat puller. B. W. Wheeler *547
Water ejector used when packing a valve. T. C. Brock *495
Welding generator detects plugged conduit. H. N. Blackmon 665
When to renew ropes on hoists and elevators. Lubeley, Young 671

(*) Illustrated. (Ed.) Editorial

Page

White paint and light *646
International Acetylene Assn.—Cleveland convention 680

J

Joint Business Conference for Economic Recovery 26

L

Labor—Ask the operator for the answer. J. O. G. Gibbons 551
Bonus based on 3-month performance in central station. N. T. Pef 258
Bonus or prize system is advantageous. Mark Bell 496
Bonus systems for power plants. Street, Van Kenyon, Rieber 100
Bonus systems for power plant employees. N. A. Miner 265
Cooperation between consultant and operator. Mark Bell 667
"I suggest we." R. B. Glen 664
Old age pensions (Ed) 114

LUBRICATION

Brush holders lubricated with graphite. W. E. Warner 608
Centrifuging diesel lubricants. Bakers, Shumaker, Wilkinson, White, Dingwall 329
Centrifuging diesel lubricants. C. C. Myers 441
Chain drives wear long if properly lubricated *118
Constant-level oilers. Frederick Wilkes. 551
Constant-level oilers give lubrication insurance *364
Diesel centrifuging. D. M. Dempsey, G.D.N. 383
Drilling oil grooves in a lathe. Frank Moore *493
Grease—what, when, why and where. J. I. Clower 408
Greases—where . . . how. J. I. Clower. *476
How diesel plants purify oil. B. E. Lingar 383
Hydrostatic lubricator from pipe and fittings. L. M. Larson *437

M

Machine Tool Show at Cleveland (Ed) ... 513
Machinery & Allied Products Institute—Surveys obsolescence 107

MANAGEMENT

Modernize for profit—the story of FHA 346
Operating brains. N. T. Pef 153
Queen of Bermuda's whistle ground and welded to prevent leaks *259
Song of sixpence (Ed) 345
Speaking of power (Ed) 488
Marine—Normandie—power plant (picture feature) 434
Towboat licks cylinder oil in boilers. A. C. Stutson *582
McGraw, James H.—50 years of publishing *339
Mechanical transmission—Key unbalances speed reducer. David Fliegelman 494
Mercury—Kearny mercury vapor station of Public Service Electric & Gas Co., N. J. *348
Metals—Coatings sprayed 143; J. W. Gibbonds *230; Sprayed metal data. A. H. Yoch 667; Spraying with metal *190
Creep of metals (A.S.M.E. meeting) 707

METERS

Developments in electricity and meters in 1934 ..... *12
Distillery plant controlled by meters. F. A. Westbrook *433
Fuel-oil meter box needs light. J. E. Wright *151
High side ammeters. H. S. Knowlton. 495
Lynn, Mass., Generating Station has difficulties with water meters. J. A. Cook. 239
Maintenance of meters *186
Meter control of stoker fired boilers *331
Scale in venturi tube may cause false readings. W. H. Peters *263
Viscometer to measure viscosity of water and steam (A.S.M.E. meeting) 692
Water gage shows head and tail water levels. F. A. Westbrook *262

MODERNIZATION

Balance savings and new investment. W. W. Gaylord 441
Broadmoor Hotel, Colorado Springs, replaces three lignite-fired boilers with one gas-fired unit. Cook, Monaghan & Tutt *528
Colgate plant in New Jersey modernizes equipment. G. A. Ambro 268
Connors Creek Station of Detroit Edison in process of being revamped. Thomas Wilson *62
Don't figure old equipment. I. A. Butcher 441
Elbow grease (Ed) 113
Ice-cream plant goes to oil firing. P. R. Unger *420
McPherson, Kan., adds power equipment to municipal steam plant. A. C. Kirkwood *236
Mack Truck Co. replaces direct radiation with unit heaters and saves oil. A. J. Morrison *594
Money for power modernization — the story of FHA 346

Page

1934 obsolescence survey measures 1934 opportunity boilers, boiler accessories, prime movers, firing equipment, feedwater systems, generators, general questions, loads and modernization .. 27
Over the fence (Ed) 401
Proper, up-to-date motors reduce costs in industrial plants. H. M. French .. *310
Rejuvenation of plant brings down heating costs. W. H. McCollum *74
Russia Cement Co., Gloucester, Mass., renovates its power plant. A. B. Reed. *240
St Croix Paper cuts steam costs 60% by modernization *570

N

National Assn. of Manufacturers & U. S. Chamber of Commerce—Joint Business Conference for Economic Recovery ... 26
National Assn. of Power Engineers—Pittsburgh meeting *562
National Board of Boiler & Pressure Vessel Inspectors—Chicago meeting 339
National District Heating Assn.—Philadelphia convention 384
New York State Society of Professional Engineers—Officers elected 337

O

OBITUARIES

Almeida, John S. 109
Anderson, Louis A. 53
Andrews, Francis M. 507
Bennett, Arthur S. 109
Bennett, Asahel F. 223
Bowers, George W. 109
Bridge, John W. 223
Brown, G. F. 53
Burleigh, William S. 564
Call, Lewis W. 452
Campbell, James 396
Champion, David J. 564
Chelstrom, Robert 681
Clark, Charles H. 339
Clore, Ralph H. 223
Cobb, Henry Z. 507
Connet, Frederick N. 396
Cook, Frederick H. 109
Cosby, Frank C. 52
Cotell, Walter F. 396
Cox, Michael F. 681
Crump, Lott 165
Dickinson, Charles P. 396
Donaghy, Samuel 564
Dooley, Charles F. 109
Elliott, Wm. S. *165
Evans, George A. 621
Fahnestock, A. Bruck 53
Gallagher, John 109
Ginty, John A. 109
Godfrey, William C. 165
Hackett, Patrick 565
Haslam, Gordon 681
Hasson, Daniel J. 52
Hatch, Frank A. 621
Hawley, George 53
Henseler, Paul 109
Hickerson, A. H. 165
Hillstrom, Hans P. 279
Hosmer, George L. 109
Ingraham, Elberton R. 452
Jasmin, Ludger 52
Jellett, Stewart 279
Johnson, B. H. 564
Junggren, Oscar 564
Kerr, R. L. 339
Ketchum, Milo 53
Kirkland, Theodore W. 339
Lacombe, C. F. 339
Lamb, Alvan G. 52
Leavitt, Austin 565
Liggett, John C. 507
Little, Arthur D. 507
Macon, Wm. W. 53, 109
Marston, Irving G. 452
McFarland, Walter M. 223
Milliken, Alexander 681
Mitchell, Harry L. 109
Moxsom, James L. 565
Newhall, E. H. 507
Newell, John I. 165
Norwood, Chester H. 507
Peters, Austin C. 165
Porter, Dwight 223
Pothier, William 507
Powell, William H. 452
Pupin, Michael I. *223
Rawley, Wayne 53
Ricketts, Palmer C. 53
Robbins, Benjamin 680
Rocktashel, Hugo 396
Rodgers, L. Lee 165
Sheldon, Frank M. 621
Silk, William J. 396
Smith, Albert S. 621
Smith, William W. 109
Spear, Grant W. 223
Stevens, Oliver 507
Stitt, Harry E. 565
Stockwell, Fred F. 53
Swendman, Joseph E. 223
Thompson, Fred C. 223
Tisdale, William F. 165
Torrey, Herbert 109
Tufts, Bowen 279
Voetsch, Charles 165
Weed, Albert C. 223
Wescott, William L. 279
Wood, John D. 452
Woodwell, Julian 621
Wortley, G. S. 621

Page

Obsolescence. See Modernization.
Oil burners—Ice-cream plant goes to oil firing. P. R. Unger *420
1934 obsolescence survey 27
Oil drilling with diesels. W. C. Lane *650

P

PIPING

Baltimore all-welded longest outdoor steam line (picture feature) 132
Building piping, identification of pipelines 93
Condensate won't drain against a hurricane. J. O. G. Gibbons 152
Design and layout of good power piping systems *83
Engine pipe failure. H. B. McDermid .. *665
Expansion bends, pipe gradient, support spacing (Power's Data Sheets) *92
How large a radius on pipe bends? C. C. Hermann *319
How to avoid trouble with water and refrigeration systems in new buildings. A. G. Solomon 648
How to bend pipe. H. R. Riley, pt. 1 *478; pt. 2 ..... *538
How to keep condensate out of conduits. Ragg, Edwards, Lingar, Pratt, Myers. 554
Insulation of cold pipes. H. M. Spring .. 668
Maintenance of piping *88
Pipe bends (A.S.M.E. meeting) 693
Pipeline drainage from boilers. Shafer, Spring, Nee, Gibbons, Kramer 499
Piping for temperatures over 850 degrees. Crocker & McCutchan *90
Pointers on installing piping to avoid troubles *86
Pointers on piping. Bernard Kramer *202
Pressure drop in pipe line used to estimate flow. E. C. Grief *210
Pressure drop in pipe line used to estimate flow. C. C. Phelps *38
Proper draining keeps air lines free of water. C. C. Phelps *150
Safety code for pressure piping 506
Seamless steel pipe data (Power's Data Sheets) 146
Steam cleaners and dryers for boilers. *642
Trouble in drinking water system caused by hydraulic elevator. R. L. Parker .. *39
Types of pipe, materials and specifications *81
Typical joints, and fittings, practical data *88
Unit heater piping. C. C. Herman *23
Van stoning wrought iron pipe *351
Waterwheel connection to wooden-pipe line. S. H. Cooke *547
What type of insulation, and how much to use *87

POWER

Federal Power Commission publishes power survey 276
Federal Power Commission survey 663
Five common power fallacies, change for arguments. P. W. Swain 19
Historical summary of "Power" 44
Industrial power discussed in connection with A.S.M.E. meeting 706
National Power Survey submits first report 106
1920-1940 (Ed) 685
Readers argue the power fallacies 142
Six pictures showing advances in power in 1934 34
Speaking of power (Ed) 376, 432
Power factor—Purchased power costs reduced at cold storage plant. W. J. Rider 209
"Power fallacies" 142

POWER PLANTS—STEAM

Broadmoor Hotel, Colorado Springs, replaces three lignite-fired boilers with one gas-fired unit. Cook, Monaghan & Tutt *528
Buzzard Point Station installs direct-contact feedwater heaters. Miller & Boho *120
Buzzard Point uses photo cells for boiler control. C. E. Miller *646
Byron Weston installs a new steam and power plant *473
Chelsea power station of Eastern Massachusetts Street Railway goes out of business 164
Cincinnati General Hospital charts its head and power *431
Clinton Cotton Mills has spotless plant. P. W. Swain *602
Colgate plant in New Jersey modernizes equipment. G. A. Anbro 268
Colorado Springs municipal plant uses electrical control to make gas firing safe *115
Connors Creek Station of Detroit Edison in process of being revamped. Thomas Wilson *62
Connors Creek stokers have automatic zoned air. Thomas Wilson *128
Copenhagen diesel pinch hits for steam plant. H. W. Pye *72
Distillery plant controlled by meters. F. A. Westbrook *433
15 years—comparison of power in 1920 and now. P. W. Swain *686
Firestone installs a 1,400-lb. boiler and a 10,000 back pressure turbine. W. K. Adkins *58
Ford adds 125,000 Kw. in turbines at Rouge plant. Thomas Wilson *66
Gold Street station of Brooklyn Edison removes old units 164

(*) Illustrated. (Ed.) Editorial

Page

Hawaiian sugar production uses bagasse for fuel with bleeder turbines. J. K. Fairchild *134
Hotel New Yorker shifts to oil. W. D. Lewis *652
Interborough Rapid Transit saves $7,000,000 power. H. B. Reynolds..... *514
Kearny mercury vapor station of Public Service Electric & Gas Co., N. J..... *348
Knickerbocker Village, R. B. Purdy..... *314
Litchfield, Minn., adds diesel generator to municipal plant. Charles Foster.. *144
Los Nietos Producing & Refining Co.'s steam turbines driven by natural gas. F. L. Kallam 201
Lynn, Mass., Generating Station has difficulties with condenser tubes and water meters. J. A. Cook 239
Magdeburg, Germany—new power house with automatic steam turbine. R. W. P. Leonhardt *307
McPherson, Kan., adds power equipment to municipal steam plant. A. C. Kirkwood *236
Milwaukee Electric Railway & Light Co. ties in. Thomas Wilson *585
Mixed power plants—how diesel can help out steam. P. M. Thayer..... *416
Normandie—power plant (picture feature) 434
Richmond station adds 165,00 more Kw. Hopping & Fairchild..... *402
Richmond Station of Philadelphia Electric *489
Russia Cement Co., Gloucester, Mass., renovates its power plant. A. B. Reed. *240
St. Croix Paper cuts steam costs 60% by modernization *570
St. Croix Paper Co. operates steam turbines from control board in boiler room. J. P. Topolosky *658
Singer building improves heat balance of plant with diesel set on springs..... *299
Steam equipment developments in 1934 *6
Steam plant developments of 1934. R. B. Purdy *2
Steam plant errors. F. H. Browning, pt. 1 *428; pt. 2 how water acts in a boiler *482; pt. 3 cutting in a boiler. *542
Tabulated data on 62 steam plants and additions in 1934 4
Textile power plant practice tends to larger units. R. M. Gates 270
West Virginia Pulp & Paper Co.'s new boiler has automatic control..... *192
West Virginia Pulp & Paper Coving plant uses automatic control for new boiler. E. H. Barry *252
West Virginia Pulp & Paper replaces two plants with one boiler. E. H. Barry. *69

POWER SERVICES

Baltimore all-welded longest outdoor steam line (picture feature)..... 132
Boilers today *629
Cheaper power with "Topping turbine." N. D. Gove 412
Cincinnati General Hospital charts its heat and power *431
Cincinnati Hospital's power service costs. A. A. Fette 608
Cincinnati Traction Building buys electric power to save 26%. F. W. Bailey. *233
Colgate New Jersey plant modernizes equipment for generating power as by-product from steam requirements. G. A. Anbro 268
Ford adds 125,000 Kw. in turbines at Rouge plant. Thomas Wilson *66
Mixed power plants — how diesel can help out steam. P. M. Thayer..... *416
Purchased power costs reduced at cold storage plant. W. J. Rider..... 209
Superheaters *636
Textile power plant practice tends to larger units. R. M. Gates 270
Watch peak loads to cut purchased power costs. J. M. Acheson *244

POWER TRANSMISSION

Chain drives wear long if properly lubricated *118
Cincinnati Waterworks went to turbine-driven pump from engine-driven pump. R. H. Rogers *122
Flat belts on short centers *366
Geared power transmission *317a
Maintenance of power transmission equipment *188
Multiple V-belts—how to select and operate them *590
Rubber belts—how they're made, used and where *248
Worm gears — selection, application, maintenance. M. M. Wills *520

POWER'S DATA SHEETS

Capacity of conveyor belting 206
Chart for determining investment return on air conditioning 604
Diesel maintenance logs 260
Expansion bends, pipe gradient, support spacing *92
Flue gas analysis checking chart..... 36
Indicator diagrams — non-releasing 4 valve engine *436
Indicator diagrams—single valve steam engine *378
Indicator diagrams—uniflow steam engine *492
Indicator diagrams—diesel engine..... *546
Refrigeration to lower wet bulb temperature 318
Seamless steel pipe data 146
Torque for various horsepowers and speeds 662

Page

PROCESS STEAM

Balancing exhaust steam with hot water demand. A. G. Behling *380
Brown Co., Berlin, N. H., raises efficiency of steam generation from surplus hydro power. F. A. Westbrook *196
Byron Weston installs a new steam and power plant *473
Clinton Cotton Mills uses process steam from turbines. P. W. Swain..... *602
Colgate New Jersey plant modernizes equipment for generating power as by-product from steam requirements. G. A. Anbro 268
Firestone installs a 1,400 boiler and a 10,000 back pressure turbine exhausting to process-steam evaporators. W. K. Adkins *58
Hawaiian sugar production uses bagasse for fuel with bleeder turbines. J. K. Fairchild *134
Why not use bleeder turbine? C. B. Robinson 152

PUBLIC UTILITIES

Colorado Springs municipal plant uses electrical control to make gas firing safe *115
Connors Creek Station of Detroit Edison in process of being revamped. Thomas Wilson *62
Erecting and maintaining generator and switchboard in far Cathay. N. L. Rea. *536
Litchfield, Minn., adds diesel generator to municipal plant. Charles Foster.. *144
McPherson, Kan., adds power equipment to municipal steam plant. A. C. Kirkwood *236
Milwaukee Electric Railway & Light Co. ties in. Thomas Wilson *585
New York's municipal power program develops three cornered fight 51
Public Service Gas & Electric Co. reviews accomplishments and plans..... 385
Richmond Station of Philadelphia Electric *489
Pulverized coal — Amount of pulverized coal burned 670

PUMPS

Automatic control for two pumps in parallel. Max Pafenbach *37
Cincinnati Waterworks prefers turbine driven pumps. R. H. Rogers *122
Constant pressure by variable speed pumps. I. L. Boyum *232
Developments in pumps in 1934..... 14
Efficiency of auxiliaries is important. H. T. Watts 265
Electrolytic action stopped in a deep well pump. E. C. Soares *208
Expansion traps cure feed pump troubles. C. W. Peters *208
Finds cause of pump having low capacity. C. W. Peters *605
High pressure feed pump operation. H. M. Spring, Jr. *250
1.5-Hp. pump replaces 15-Hp. unit. K. A Frank *548
Jumping of direct acting steam pump.. 442
Phosphor bronze sprayed on pumps.... 143
Plugged line wrecks pump during cleaning. W. E. Warner 607
Pump, piping to use for a spring..... 42
Sillre, Sweden, builds a pumped storage plant. George Willock *138
Suction head on pump when handling hot water. W. E. Warner 497
Suction head on pump to handle hot water 264
Valve replacement needed, not new pump. P. Scagne *149
Variable load analyzing. G. C. Boyer... *370
Water for sluicing ash. White, Karassik, Myers, Pratt, Kraus, Butcher..... 555
What is head on a pump? F. A. Kristal. *573
Where to put brine pump. Martin, Karassik 155

R

Refractories. See Boilers.

REFRIGERATION

Cooling for comfort. R. B. Purdy..... *530
Cooling towers at Macy's. Mosher & Wellbrock *656
Drying methyl chloride. E. W. McGovern *579
Electric control valves for refrigerating systems. W. R. Kitzmiller *124
How to avoid trouble with water and refrigeration systems in new buildings. A. G. Solomon 648
Humidity control with brine spray. W. H. Martin 20
Refrigeration to lower wet-bulb temperature (Power's Data Sheets)..... 318
Steam jet refrigeration (N.D.H.A. meeting) 384
What causes knock in compressor. Edwards, Wolf, Strok 43
Where to put brine pump. Martin, Karassik 155
Research—A.S.M.E. discusses research... 706
Cavitation research (A.S.M.E. hydraulic session) 697

S

SMOKE ABATEMENT

Boston's smoke problem 506
Britain pays more to keep sulphur from flue gas. David Brownlie..... *426
Filtering conditioned air. R. B. Purdy.. *254

Page

Hudson County, N. J., saves by smoke abatement 163
Modern dust collectors (A.S.M.E. meeting) 707
Precipitator vs. cyclone. Henry Kreisinger 123
Precipitator vs. cyclone. N. T. Pef..... 382
Safe furnace proportions prevent smoke. H. R. Carr *596
Seattle Gas Co. reduces smoke by higher stack and smoke alarms. J. F. Pollard. *518
What about smoke abatement? O. P. Hood *242
Smoke Prevention Assn.—St. Louis meeting 395
Spraying with metal *190; J. W. Gibbons *230; A. H. Yoch 667
Squish 119

STEAM

Condensate under pressure 266
Eliminating oil from engine exhaust. E. J. Vonacben 153
Separating oil from exhaust steam. Frank McLean 150
Viscosity of water and steam (A.S.M.E. meeting) 692

STOKERS

Coal feed regulator. F. T. Pollock..... *324
Connors Creek stokers have automatic zoned-air control. Thomas Wilson.... *128
Fuels session of A.S.M.E. discusses stokers 694
Mechanicoaling (picture feature)..... 33
Maintenance in the boiler room..... *173
1934 obsolescence survey 27
Sun-power. E. D. Wilson *517
Superheaters—Superheater circulation to prevent overheating. Bock, Myers, Kee, Grief, White, Pef 212

T

Tanks—Elevated equipment needs obstruction lights. S. H. Coleman 150

TURBINES—STEAM

Buzzard Point station installs direct-contact feedwater heaters. Miller & Boho *120
Byron Weston installs a new steam and power plant *473
Cheaper power with "topping turbine. N. D. Gove 412
Cincinnati Waterworks went to turbine-driven pump from engine driven pump. R. H. Rogers *122
Depression's effect on purchases of turbine-generator sets. L. E. Newman.. *234
Extraction turbine to supply process steam. C. B. Robinson 152
15 years—comparison of power in 1920 and now. P. W. Swain *686
Firestone installs a 14,000 lb. boiler and a 10,000 back pressure turbine. W. K. Adkins *58
Hawaiian sugar production uses bagasse for fuel with bleeder turbines. J. K. Fairchild *134
Los Nietos Producing & Refining Co.'s steam turbines driven by natural gas. F. L. Kallam 201
Magdeburg, Germany—new power house with automatic steam turbine. R. W. P. Leonhardt *307
1934 developments in steam equipment *6
1934 obsolescence survey 27
Oil on blading threw turbine out of balance. H. M. Spring, Jr. 149
Russia Cement Co., Gloucester, Mass., renovates its power plant and changes to steam turbines. A. B. Reed..... *240
Testing steam turbines (A.S.M.E. meeting) 692
Thermostatic traps drain standby turbines. S. H. Coleman..... 379
Turbine and engine overhauling..... *177
Turbine-blade deposits (A.S.M.E. meeting) 699
Unchaperoned turbines. J. P. Topolosky. *658
Variable load analyzing. G. C. Boyer.. *370

V

VALVES

Automatic valve control exhaust pressure. F. E. Bateman *94
Electric control valves for refrigerating systems. W. R. Kitzmiller..... *124
Hanger for valve chains. S. H. Coleman *325
Operates fuel-oil valve from damper regulator. C. B. Hudson *606
Operation of 6-in. valve from a belt step. Bernard Kramer 551
Pressure drop in pipe line used to estimate flow. C. C. Phelps *38
Tagging safety valves. B. R. Brown.. 208
Valve-seat puller. B. W. Wheeler.... *547
Water ejector used when packing a valve T. C. Brock *495

W

WATER POWER

Boulder Dam aerial photograph..... 545
Boulder Dam discussed at A.S.M.E. meeting 373
Boulder Dam turbines (picture feature) 661
Brown Co., Berlin, N. H., raises efficiency of electric steam boiler 50%. F. A. Westbrook *196

(*) Illustrated. (Ed.) Editorial

Page

Canadian hdyro-electric unit tested by motorizing its twin. A. J. F. Montabone 194
Centrifugal pumping trends in waterworks practice 221
Dixence, Switzerland, uses welded penstocks for 5,742 ft. static head. R. W. Miller 321
Dnieprostroy project discussed at A.S.M.E. meeting 373
Gage shows head- and tail-water levels. F. A. Westbrook *262
His Majesty's power house. N. L. Rea.. *308
Hydraulic session of A.S.M.E. discusses cavitation 697
Hydro electric power development in 1934. F. A. Annett (charts and tables) 15
Hydro way out west (picture feature).. 377
Norris Dam building telescopic exciters 480
Passamaquoddy project to be built by government *338
Penstock accidents in 1934 235
Shoe-type guide bearings for hydro generators. R. Baudry *541
Sillre, Sweden, builds a pumped storage plant. George Willock *138
Tabulated data on hdyro electric projects in U. S. and Canada in 1933 and 1934 16
Turbines for Kanawha, Boulder and Norris *481
U. S. Potential water power 164
Water wheels—1934 obsolescence survey. 27
Waterwheel connection to wooden-pipe line. S. H. Cooke *547
Waterwheel with micarta-lined bearings. V. Enz *407
Weather conditions increase load 66% 493

Page

WELDING

Ammonia compressor repaired by bronze welding. W. D. Wilkinson, Jr..... *666
Baltimore all-welded longest outdoor steam line (picture feature)..... 132
Bearing of turbine-generator repaired by welding. G. W. Devine *549
Drums and headers for boilers..... *644
Electroplating closes pores in cast iron weld. L. H. Kendall *207
Maintenance by arc. C. M. Taylor..... *229
Queen of Bermuda's whistle ground and welded to prevent leaks *259
Safe ending extends life of boiler tubes. H. A. Wiggins 152
Welding, hard facing and metal spraying as maintenance tools *190
Wire rope, rules for long and safe life of. A. J. Morgan 336

AUTHORS' INDEX

ABBOTT, W. L. Coal consumption in British plant 550.
Acheson, Jon M. Watch maximum demand to cut power costs *244.
Adkins, William K. Firestone goes up to 1,400 lb. pressure at Akron 58.
Alexander, C. L. Burns bituminous coal and lignite in combination *548. Keep burner boxes free of pulverized coal *494.
Alt, Harold L. Heating New York's largest post office *418. Ventilating New York's largest post office *354.
Anbro, Gosta A. More power for Palmolive 268.
Anderson, J. W. Whither diesel bearings? 200.
Annett, F. A. Water power (charts and tables) 15.
Armstrong, Charles A. Before the elevator starts *526. Desk and roll for log sheets *607. Starts group of motors with single auto-transformer *96. Straight line diagrams simplify elevator control *423. Watch that water column 381.
Ashmore, George H. Boiler tubes replaced in two parts 440.

BAILEY, F. W. Buys power to save 26% *233.
Baker, R. C. Boiler vent open or closed when filling 267. Building up oil circuit breaker contacts 268. Centrifuging diesel lubricants 329. Dial gage checks alignment 382. Protecting air compressors against explosions 388.
Barnes, Robert. Boiler vent open or closed when filling 267.
Barry, C. E. Should shoulders be put on wristpins 388.
Barry, E. H. Large boiler operation goes automatic *252. One boiler replaces two plants *69.
Bateman, F. E. Automatic valve controls exhaust pressure *94.
Baudry, R. Shoe-type guide bearings for hydro generators *541.
Beckert, E. H. Circuit breaker contacts stand severe service *441.
Behling, A. G. Balancing exhaust steam with hot water demand *380.
Bell, Mark. Aligning bearings on a motor-generator 329. Bonus or prize system is advantageous 496. Diesel exhaust heat rises steadily 611. Federal licensing 609. Operator knows 667.
Benson, Arnold. Changes in rectifier double life of tubes *264.
Bentley, Frank. Brick cleaning cleaver made from automobile spring, *37.
Betz, L. D. Dispersed organic colloids help in feedwater deaeration 497.
Blackmon, Hendley N. Welding generator detects plugged conduit 665.
Bock, L. G. Superheater circulation to prevent overheating 212.
Bohlinger, Wm. Coating eliminates tank sweating 605.
Boho, M. J., and C. E. Miller. Operating contact heaters *120.
Boyer, Glenn C. Variable load analyzing *370.
Boyum, I. L. Constant pressure by variable speed pumps *232.
Brock, Thomas C. Uses water ejector when packing a valve *495.
Brockner, P. R. Cleaning oil from piping 671.
Brodsky, Julius. Improper soot-blower installation caused boiler-tube failure *151.
Brown, B. R. Tagging safety valves 208.
Brown, Lawrence B. Feedwater heater made of pipe and fittings *549.
Brown, R. C. Handy sheet metal punch *39.
Browning, Frank H. Steam plant errors, pt. 1 premises *428; pt. 2 how water acts in a boiler *482; pt. 3 cutting in a boiler *542.
Brownlie, David. Britain pays more to keep sulphur from flue gases *426. Tir John, new British station, burns anthracite *645.
Bruhl, Paul C. Tool for measuring circular sections *379.
Butcher, Ira A. Don't figure old equipment 441. Water for sluicing ash 556.

CANNEY, A. WARREN. How much conditioned air? *368. Quiet fans for air conditioning *424.
Carr, Hugh R. Safe furnace proportions prevent smoke with underfeed stokers *596.
Carter, Charles W., Jr. Boiler tube replaced in two sections 97.
Cater, C. J. Supercharges or another diesel 41.
Clower, James I. Grease—what, when, why and where 408. Greases—where . . . how *476.
Coleman, S. H. Efficiency of all auxiliaries is important 550. Hanger for valve chains *325. Maintain generator bearing pedestal insulation 96. Operating engineer remembers 153. Provide access doors for slag removal 493. Put obstruction lights on elevated equipment 150. Thermostatic traps drain standby turbines 379.
Cook, E. H., J. J. Monaghan and C. L. Tutt, Jr. One boiler replaces three *528.
Cook, James A. Operating problems at Lynn 239.
Cook, Marcus. Bacteria immune to chlorine 612. Standby boiler corrosion 498.
Cooke, S. H. Safety-first steam hose connections *38. Waterwheel connection to wooden-pipe line *547.
Credgo, H. A. Insulated stack to prevent corrosion *209.
Crocker, Sabin, and Arthur McCutchan. Piping for temperatures over 850 degrees *90.
Curtiss, H. C. Formula for diameter of a circle 496.
Cuthbertson, W. R. Boiler vent open or closed when filling 266.

DEMPSEY, DEWEY M. Tips on diesel centrifuging 383.
Devine, George W. Turbine-generator bearing repaired by welding *549.
Dickson, J. W. Diesel exhaust heat rises steadily 610.
Dingwall, Wm. W. Centrifuging diesel lubricants 330. Diesel exhaust heat rises steadily 160.
Dixon, C. F. Boiler capacity ratings *429.
Dunn, W. R. Standby boiler corrosion 499.

EDGECUMBE, J. C. Special guide shoe gibs quiet elevator cars *147.
Edwards, Zanzie. How to keep condensate out of conduits 555. What causes knock in compressor 43.
Emerson, R. F. Untouched by human hands *524.
Emison, Roy. Distance gage for liquid level 97.
Enz, V. Micarta-lined waterwheel bearings *407.

FAIRCHILD, F. P., and E. L. Hopping. 165,000 Kw. more in Richmond Station *402.
Fairfield, John G. Check flue gas analysis without computation *25.
Fairchild, J. K. Bagasse to Hawaiian sugar via bleeder turbines *134.
Fernow, B. E. Something for nothing by supercharging diesels? 211.
Fette, Anthony A. Power service costs in a hospital 608.
Fliegelman, David. Key unbalances speed reducer 494.
Foster, Charles. Litchfield's power *144.
Frank, K. A. 1.5 hp. pump replaces 15-hp. unit *548.
French, D. K. What about condenser tube scale? 44.
French, H. M. Proper, up-to-date motoring pays its own way *310.

GATES, ROBERT M. Textile power-plant practice tends to larger units 270.
Gaylord, William W. Balance savings and new investment 441.
Gibbons, James O. G. Ask the operator for the answer 551. Condensate won't drain against a hurricane 152. Fallacy No. 6 326. 1 cu.ft. air burns 100 B.t.u. 413. Pipeline drainage from boilers 500 Plant will run one second on header storage *21. Do's and don'ts for the sprayer of metals *230.
Gilbert, E. A. Bends tubes to install them in boiler *382.
Glen, Ray Barr. Changes connections to correct rotary-converter trouble *665. Defective connections cause trouble 437. "I suggest we" 664. Remodeled oil switch heated excessively 607. Rotary converter operates with shunt field open 547.
Gouchnauer, H. W. Weather conditions increase load 66% 493.
Gove, N. D. Cheaper power with the "topping turbine" 412.
Green, Charles A. Anecdotes of two old engines 199.
Green, Edward. How to burn lignite 322.
Grief, E. C. Pressure drop in pipe line used to estimate flow *210. Superheater circulation to prevent overheating 213.
Guildford, R. P. A.C. motors—torques, currents, slip *576.

HAFFORD, R. A. Cutting in a boiler 668.
Hall, R. A. Devices method for making spiral spring *438. New disks on old valve stems *379.
Hankins, Richard P. Federal licensing 609.
Harden, C. G. Protecting air compressors against explosions 387. Zoned heating a 30-story building 214.
Hearn, David. Removing paint from transformer radiators *323.
Hege, B. F. Condenser scale 263.
Hermann, C. C. Don't throw away used refractories 533. Unit heater piping *23. How large a radius on pipe bends? *319.
Hill, M. S. Automatic landing with car switch elevators *256.
Hoffman, K. B. Building up oil circuit breaker contacts 268. Degree-day and wind velocity 443. Deterioration of rubber covered wire 154. Eliminates dust to prevent brushes sticking in holders 327. What about condenser tube scale? 210. Zoned heating a 30-story building 214.
Hoppin, E. L., and F. P. Fairchild. 165,000 Kw. more in Richmond Station *402.
Holaday, K. M. What about condenser tube scale? 44, 210.
Hood, O. P. What about smoke abatement? *242.
Howarth, H. A. S. Thrust bearings loaded to destruction 211.
Hudson, C. B. Operates fuel-oil valve from damper regulator *606.
Humphrey, H. B. Thermal relays tripped by high ambient temperatures 151.
Humphrey, K. B. Synchronizing a small hydro generator 95.
Hunt, J. R. Standby boiler corrosion 499.
Hunt, L. A. Aligning bearings on a motor generator 328. Tightening loose stator cores *437.
Hyler, John E. Make electrical controls tinker proof 211.

JOHNSTON, W. S. Boiler vent open or closed when filling 266. 50,000 tons of experience with buckwheat No. 4 486.

KALLAM, F. L. Natural gas drives steam turbines 201.
Kalwitz, George J. Electric heat controls humidity 243.
Karassik, I. J. Water for sluicing ash 555. Where to put brine pump 155.
Kee, C. E. Superheater circulation to prevent overheating 213.
Kendall, L. H. Electroplating closes pores in cast-iron weld. *207.
Kennedy, Bunyan. Makes flared nipple from pipe coupling *666.
Kenyon, Van. Bonus systems for power plants 100.
Kirkwood, A. C. Service as usual during alterations *236.
Kitzmiller, W. R. Electric control valves for refrigerating systems *124.
Knowlton, H. S. Advantages of using high side ammeters 495. Use of transformer reactors, 494.

(*) Illustrated. (Ed.) Editorial

Korn, Arthur. Here's a unit for judging compressors *312.
Kramer, Bernard. Does a trap consume steam? 442. Easily made beam clamp pipe hanger *96. More about piping *202. Operation of 6-in. valve from a belt step 551. Pipe line drainage from boilers 500.
Kraus, Milton N. Does a trap consume steam? 442. Water for sluicing ash 556.
Kreisinger, Henry. Precipitator vs. cyclone 123.
Kristal, Frank A. What is head on a pump? *573.

LANE, W. C. Diesels drill for oil *650.
Larson, Lawrence M. Aligning bearings on a motor generator 329. Built hydrostatic lubricator from pipe and fittings *437.
Latta, J. G. Building a pit engine muffler *325. Round chart meter makes time recorder *438.
Leonhardt, R. W. P. Automatic steam turbine *307.
Lewis, Warren D. Hotel New Yorker shifts to oil *652.
Lieberg, Fred W. Vacuum cleaning the power plant *352.
Lingar, Benjamin. Bacteria immune to chlorine 612. Cleaning oil from piping 670. How diesel plants purify oil 383. How to keep condensate out of conduits 555. Oil flash point and compressed air explosions 440.
Long, Leonard. Aligning bearings on a motor generator 329.
Lubeley, A. J. When to renew rope on hoists and elevators 671.
Ludwickson, James K. Engine supercharged with an exhaust-gas turbine blower 326.
Lynn, C. Improve commutation for better operation. *410.

MARTIN, WALLACE, H. Humidity control with brine spray 20. Where to put brine pump 155.
McBreen, Charles W. Soft spots in steam generation 130.
McCollum, W. H. Down went heating costs *74.
McCutchan, Arthur, and Sabin Crocker. Piping for temperatures over 850 degrees *90.
McDermid, H. B. What caused the steam header fitting to fail? *665.
McGovern, E. W. Drying methyl chloride 579.
McLaren, R. Preventing explosions in compressed-air systems 550.
McLean, Frank. Separating oil from exhaust steam 150.
Merrill, A. A. Scaling your charts *148.
Miller, C. E. Buzzard Point uses photo cells for boiler control *646.
Miller, C. E., and M. J. Boho. Operating contact heaters *120.
Miller, R. W. Welded penstocks used for 5,742 ft. static head 321.
Miller, T. E. Small fuse adapted for use in heavy clips *37.
Miner, Nelson A. Bonus systems for power plant employees 265.
Monaghan, J. J., E. H. Cook, and C. L. Tutt, Jr. One boiler replaces three *528.
Montabone, A. J. F. Motorized a hydro unit 194
Montgomery, T. B., P. M. Stivender, and L. A. Selleg. Automatic regulator maintains constant bus voltage *136.
Moore, Frank. Drilling oil grooves in a lathe *493.
Moore, H. Ladder tool rest for refacing pulleys *605. Piece of belting makes step to reach valve *325. Transfer holes from cylinder to cylinder head *94.
Morgan, A. J. Rules for long and safe wire rope life 336.
Morrison, Andrew J. Unit heaters save 118,000 gal. of oil *594.
Mosher, Fred D., and R. Wellbrock. Cooling towers at Macy's *656.
Munch, Arthur. Bolt starter for use in small space *264.
Myers, C. C. More on centrifuging 441.
Myers, J. M. Aligning motor-generator with rotors in place *440. Building up oil circuit breaker contacts 268. Deterioration of rubber covered wire 154. How to keep condensate out of conduits 555. Superheater circulation to prevent overheating 212. Water for sluicing ash 556.

NEE, RAYMOND M. Pipeline drainage from boilers 500. Standby boiler corrosion 498. Zoned heating a 30-story building 214.
Newman, L. E. Above 250 lb. favored for new steam turbines 234.
Noble, James E. Boiler tube replaced in two sections 210.
Norris, T. F. Adjustments rejuvenate combustion control *22.
Nye, M. C. Boiler vent open or closed when filling 267. Frequency of explosions has been reduced 440.

OATLEY, HENRY C. Power plant chimneys —how high? what diameter? *246.
O'Brien, Joseph. Not bonus, but interest 383.
O'Regan, W. F. Should shoulders be put on wristpins 388.

PAFENBACH, MAX. Automatic control for two pumps in parallel *37. Poor foundation caused generator to vibrate 207. Voltage affects d.c. machine parallel operation 381.
Parker, Leo T. Who is liable? 552.
Parker, R. L. Hydraulic elevator causes trouble in drinking-water system *39.
Pef, N. T. Boiler vent open or closed when filling 267. Bonus based on 3-month performance 258. How to avoid sticking coal 101. Operating brains 153. Precipitator vs. cyclone 382. Sixteen tubes fail in boiler 439. Superheater circulation to prevent overheating 213.
Peters, C. W. Expansion traps cure feed pump troubles *208. Finds cause of pump having low capacity *605. Should shoulders be put on wristpins 388.
Peters, W. H. Scale in a venturi tube may cause false readings *263.
Phelps, Charles C. Pressure drop in pipe line used to estimate flow 38. Proper draining keeps air lines free of water *150.
Phelps, H. R. Fan forecasting 195.
Pierce, Conway. How to avoid sticking coal 101.
Pollard, James F. Seven-eighths less smoke *518.
Pollock, F. T. Automatic coal feed regulator *324.
Pomeroy, J. M. Emergency repair on air-compressor valve stud *262. Release the brake when gaging hoist motor 210.
Powell, Sheppard T. Chemical deaeration of boiler feed water, pt. 1 304; pt. 2 *362.
Pratt, Willard D. How to keep condensate out of conduits 555. Water for sluicing ash 556.
Purdy, R. B. Air washers provide moisture to order *140. Conditioned air; no drafts 580. Cooling for comfort *530. Dust takes a holiday when filters clean conditioned air *254. It ain't the heat—it's the humidity *76. Knickerbocker Village *314. Steam plants *2. Summer weather in winter 320. Where the air washer? *197.
Pye, H. Walter. Largest diesel pinch-hits for steam *72.

RAGG, F. C. How to keep condensate out of conduits 554.
Rea, N. L. Back of beyond *204. His Majesty's power house *308. In far Cathay *536.
Reed, Alonzo B. "Life begins at fifty" for Russia Cement Company's power plant *240.
Reed, M. J. Tulsa meeting stresses diesels in the oil fields 294.
Reidl, A. L. Zoned heating a 30-story building 213.
Reill, C. Tyson. Protecting air compressors against explosions 386.
Reynolds, Herbert B. $7,000,000 saved by Interborough Rapid Transit *514.
Rider, Walter J. Corrects power factor and cuts power costs 209.
Rieber, A. F. Bonus systems for power plants 100. Why compressor explosions *522.
Riley, H. L. How to bend pipe, pt. 1 *478; pt. 2 *538.
Rivett, E. Scott. Protecting air compressors against explosions 387.
Robinson, Chester G. Should engineers have federal licenses? 496.
Robinson, C. B. Why not use bleeder turbine? 152.
Rocklin, Abe. Improved heating system temperature control 323. Stationary air compressor made portable 605.
Rogers, R. H. Cincinnati Waterworks went to turbine-driven pump from engine-driven pump *122.

SCAGNE, P. New valves needed, not a new pump *149.
Schneider, John H. Federal licensing 609.
Selleg, L. A., T. B. Montgomery, and P. M. Stivender. Automatic regulator maintains constant bus voltage *136.
Shafer, E. W. Pipeline drainage from boilers 499.
Sheen, Robert T. Here's how to balance boiler water 654.
Shumaker, V. F. Centrifuging diesel lubricants 329.
Sidler, Paul R. Superchargers or another diesel *40.
Soares, Eustace C. Electrolytic action stopped in a deep well pump *208.
Solberg, Thorvald A. How to burn cracked fuel oils 32.
Solomon, A. G. To start with cool, clean, drinking water 648.
Spring, Harry M. Cleaning oil from piping 670. Insulation of cold pipes 668. Pipeline drainage from boilers 500. Standby boiler corrosion 499. Boiler tube replaced in two sections 97. Hp. feed-pump operation *250. Oil on blading threw turbine out of balance 149. Repairs bulged furnace sheet *95.
Stafford, H. E. Peak load indicator sounds alarm *262. Uses file on a rest for truing collector rings *380.
Starkweather, W. L. Bacteria immune to chlorine 612.
Sterrett, Elton. Excessive temperature caused gas-engine magneto trouble *149. Prevents oil leaks from air cleaner *209. Tightens gas engine exhaust valve seat *439.
Stivender, P. M., T. B. Montgomery, and L. A. Selleg. Automatic regulator maintains constant bus voltage *136
Stevens, R. M. Make sure of induction motor bearings 94.
Stoddard, H. G. Make flash light into test lamp *494.
Stoffel, L. L. Troubles electro-plating generator brushes 667.
Street, Thomas M. Bonus systems for power plants 100. Engine indicator records boiler blowdown *323.
Strok, Fred. What causes knock in compressor 44.
Strong, H. L. Degree day and wind velocity 443.
Stutson, A. C. Towboat licks cylinder oil in boilers *582.
Swain, Philip W. 15 years . . . *686. Spotless Dixie plant *602. These are power fallacies 19.

TANGERMAN, E. J. Diesel engines 10.
Taylor, C. M. Maintenance by arc *229.
Thayer, Paul M. Mixed power plants *416. Shrewd diesel plant design means cheaper power 126.
Topolosky, John P. Unchaperoned turbines *658.
Trumpler, William E. Combustion turbine—a future prime mover? *78. Internal-combustion turbine *532.
Tutt, C. L., Jr., E. H. Cook, and J. J. Monaghan. One boiler replaces three *528.

UNGER, PAUL R. Ice-cream plant goes to oil firing *420.

VAKSDAL, ALFRED. Corning fights the flood *422.
Vonachen, E. J. Eliminating oil from engine exhaust 153.

WAGNER, M. E. Cause of false water level in water column 153. Compressed air explosions can be prevented 608.
Warner, W. E. Explosion in coal pulverizing plant 96. Lubricates brush holders with graphite 608. Plugged line wrecks pump during cleaning 607. Suction head on pumps when handling hot water 497. Why brushes stick in holders 211.
Warren, S. A. Rubber tubing for manhole gaskets *381.
Watts, H. T. Efficiency of auxiliaries is important 265.
Welch, James A. How to avoid sticking coal 101.
Welch, William, Jr. Bacteria immune to chlorine 611.
Wellbrock, R., and F. D. Mosher. Cooling tower at Macy's. *656.
Westbrook, Francis A. Boils water at 22,000 volts *196. Control by meter *433. Gage shows head and tail water levels *262.
Wheeler, Burton W. How to build a monolithic baffle *198. Valve-seat puller that does the job easily *547.
White, Homer D. Centrifuging diesel lubricants 330. License the diesel engineer 668. Water for sluicing ash 555.
White, John L. Superheater circulation to prevent overheating 213.
White, K. M. How to measure elevator service *357.
Wiggins, H. A. Safe ending extends life of boiler tubes 152.
Wilkes, Frederick. Constant-level oilers 551.
Wilkinson, H. P. Centrifuging diesel lubricants 329.
Wilkinson, W. D., Jr. Old compressor repaired by bronze-welding *666.
Willey, Charles H. Simple universal jointed packing screw *39.
Williamson, R. Protecting air compressors against explosions 388.
Willis, Philip A. Not diesel power for nothing but better efficiency *326.
Willock, George. Sweden builds a pumped storage plant *138.
Wills, M. M. Worm gears—selection, application, maintenance *520.
Wilson, E. D. Power from the sun *517.
Wilson, G. C. Fuel for high-speed diesels 553.
Wilson, Thomas. Automatic zoned air for Conners Creek stokers *128. Ford adds 125,000 Kw. at Rouge *66. Port Washington ties in *585. Revamping Connors Creek *62.
Wolf, Ray B. What causes knock in compressor? 43.
Wood, Walter H. Test your own boilers, pt. 1 *302; pt. 2 *360; pt. 3 *414; pt. 4 *485; pt. 5 534; pt. 6 *596.
Woodle, A. S., Jr. Protecting air compressors against explosions 387.
Wright, J. E. Defective primary lead causes noisy transformer operation 438. Emergency lights for boiler room *381. Installs light in fuel oil meter box *151. Shaded pole type motor reversed *495.

YOCH, A. H. New sprayed metal data 667.
Young, J. L. Building up oil circuit breaker contacts 268. Degree-day and wind velocity 443. Deterioration of rubber covered wire 154. Tightening large feed water storage tanks *439. When to renew rope on hoists and elevators 671.
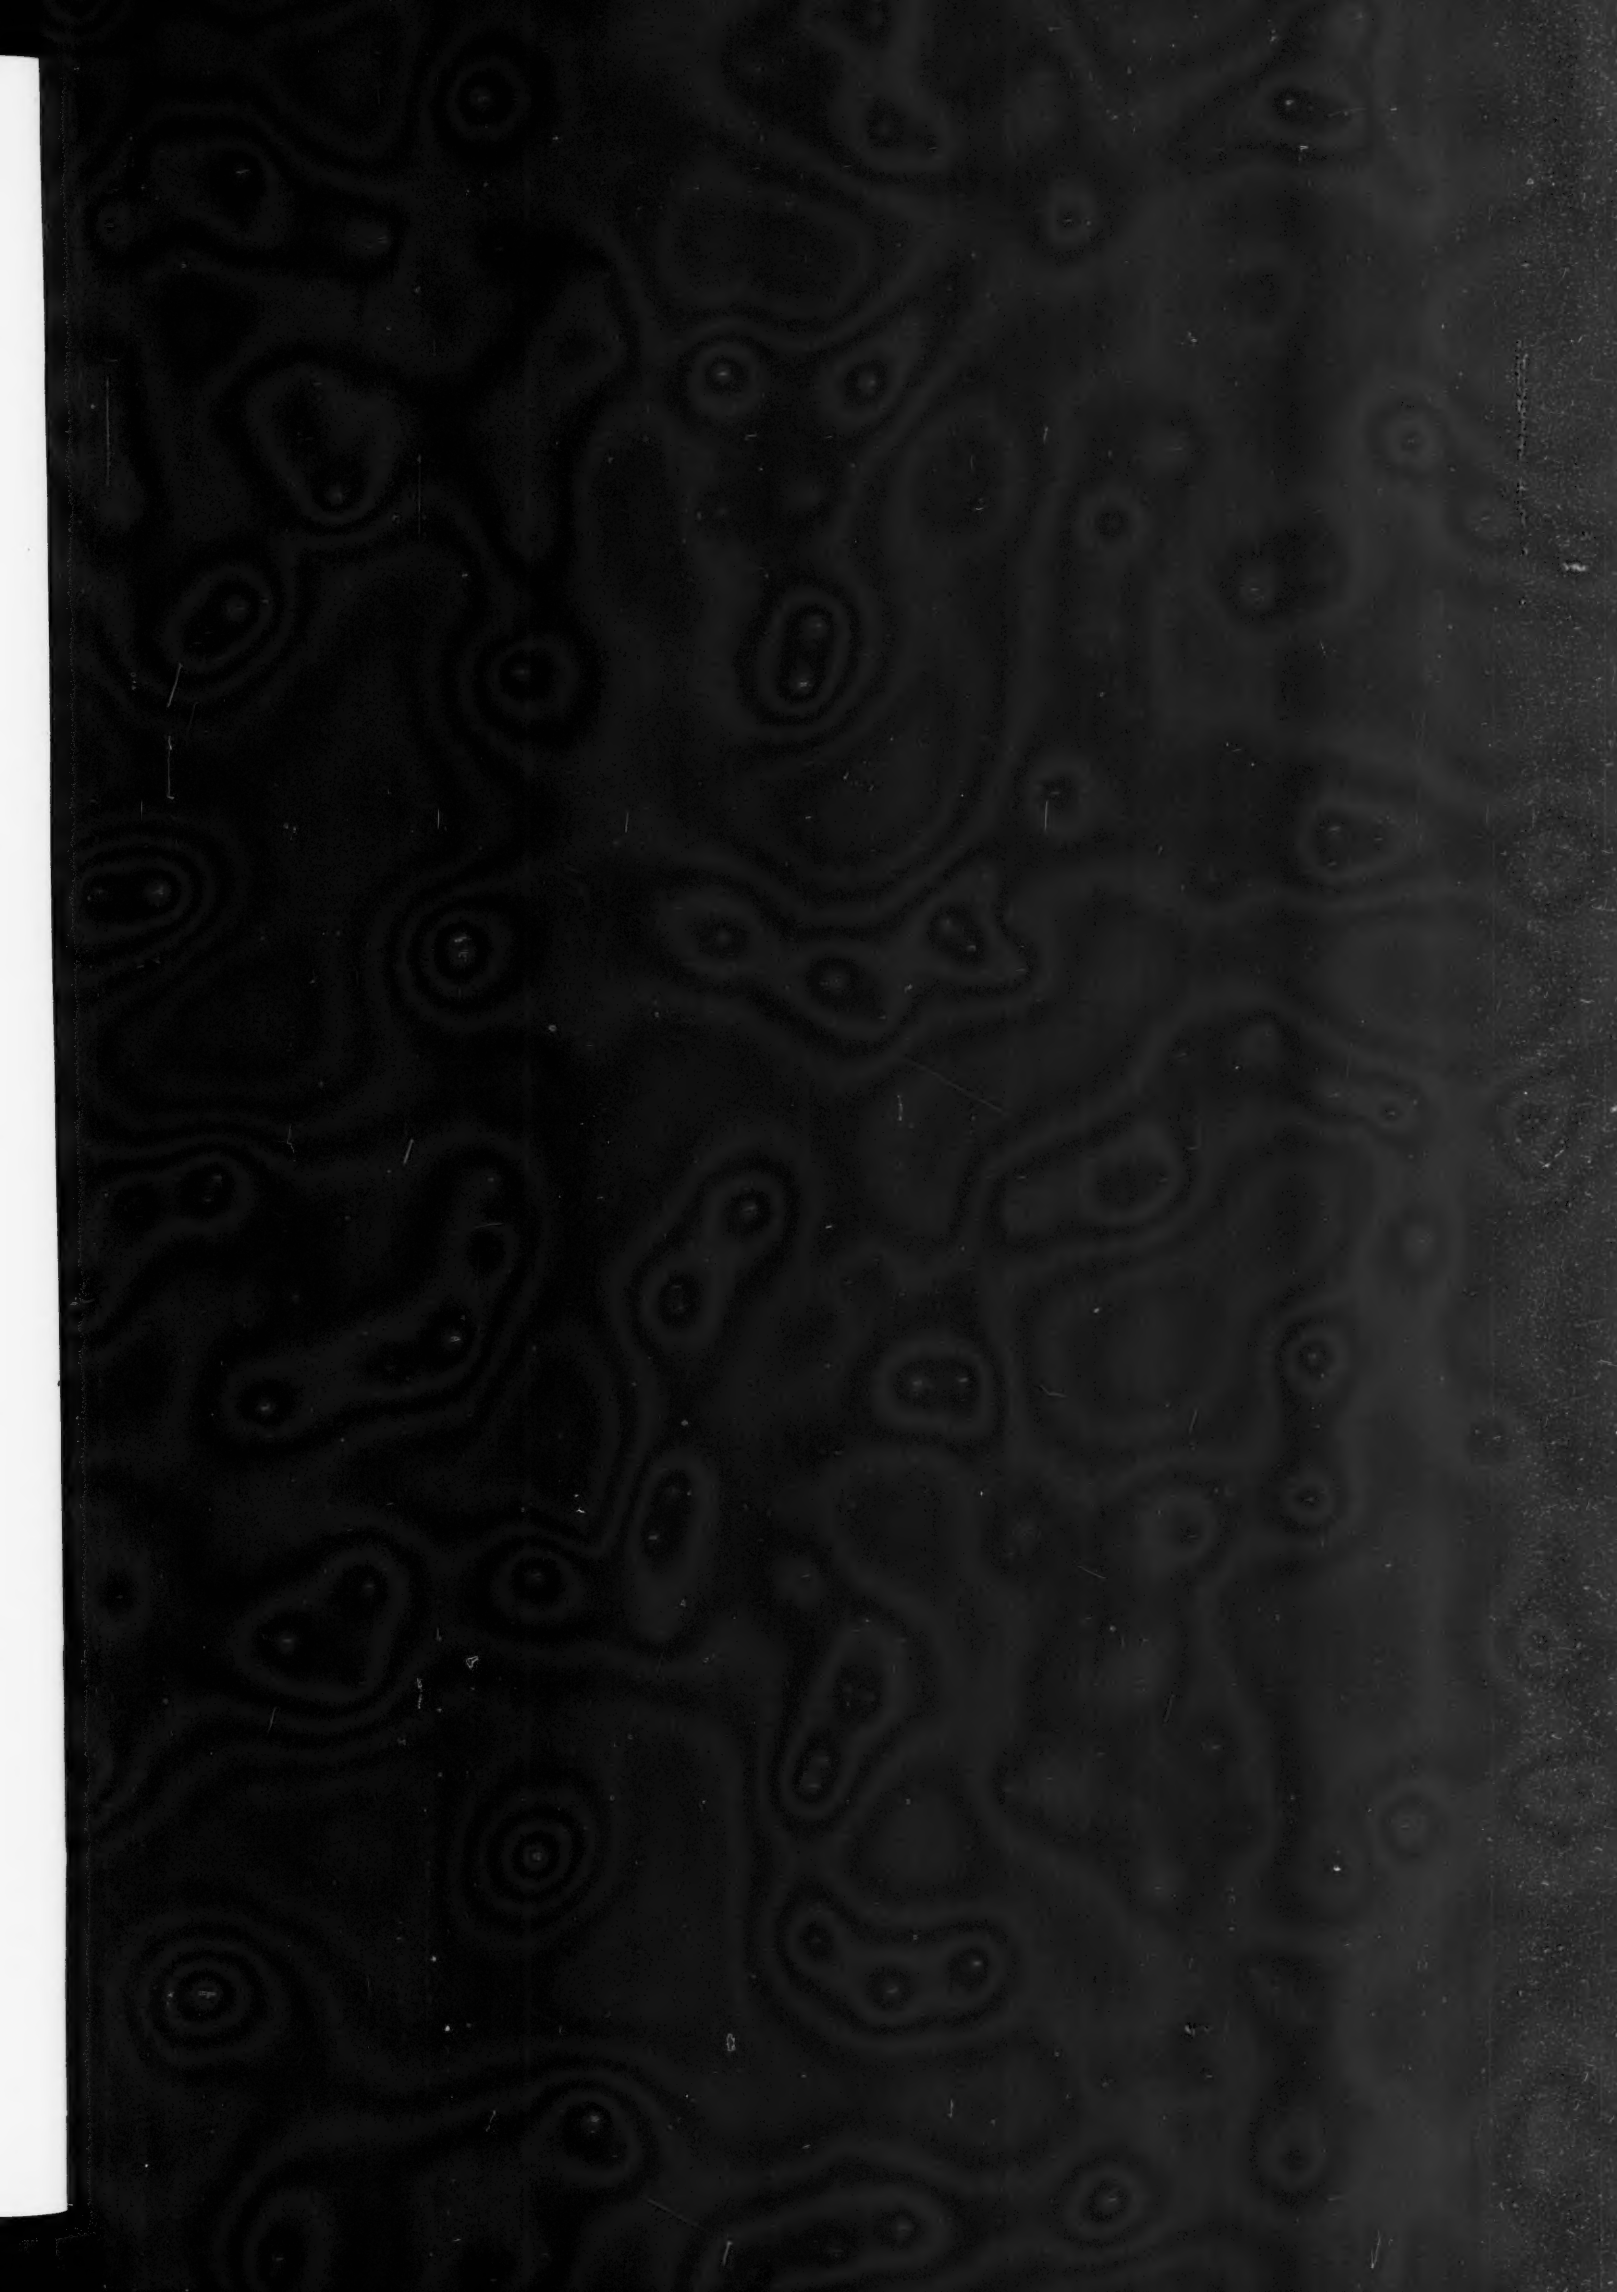
(*) Illustrated. (Ed.) Editorial